

DESIGN OF A HYDRO - ELECTRIC  
STEAM POWER PLANT

E. D. MAC EWING

ARMOUR INSTITUTE OF TECHNOLOGY

1910

537.84  
M 268



Illinois Institute  
of Technology  
**UNIVERSITY LIBRARIES**

AT 190

MacEwing, E. D.

Design of a 1500 K.W.

hydroelectric and auxiliary

**For Use In Library Only**







DESIGN  
OF A  
1500 K.W. HYDROELECTRIC  
AND  
AUXILIARY STEAM POWER PLANT

A THESIS

PRESENTED BY

E.D. MacEwing

TO THE

PRESIDENT AND FACULTY

OF

ARMOUR INSTITUTE OF TECHNOLOGY

FOR THE DEGREE OF

BACHELOR OF SCIENCE IN ELECTRICAL ENGINEERING

HAVING COMPLETED THE PRESCRIBED COURSE OF STUDY IN

ELECTRICAL ENGINEERING 31

MAY 1910

ILLINOIS INSTITUTE OF TECHNOLOGY  
PAUL ALLEN LIBRARY  
35 WEST PULASKI STREET  
CHICAGO, IL 60616

*E. G. Freeman*  
Prof. of Elect. Eng.  
*H. M. Raymond*  
Dean. Eng. Studies  
*A. C. Morrison*  
Dean of Civil Studies









557.84  
M268

## INDEX.

Page.

PROJECT.....	1
Local Conditions.	
BUILDING.....	1
TURBINES.....	2
GENERATORS.....	3
EXCITERS.....	4
AUXILIARY MACHINERY.....	4
SWITCHBOARD.....	4
AUXILIARY STEAM PLANT.....	7
MECHANICAL DRAFT.....	7
PUMPS.....	8
FEED WATER HEATER.....	8
TURBO-GENERATORS.....	8
CONDENSERS.....	9
STEAM PIPING.....	10
EXHAUST PIPING.....	10

1	.....	PROBANT
2	.....	.....
3	.....	.....
4	.....	.....
5	.....	.....
6	.....	.....
7	.....	.....
8	.....	.....
9	.....	.....
10	.....	.....
11	.....	.....
12	.....	.....
13	.....	.....
14	.....	.....
15	.....	.....
16	.....	.....
17	.....	.....
18	.....	.....
19	.....	.....
20	.....	.....
21	.....	.....
22	.....	.....
23	.....	.....
24	.....	.....
25	.....	.....
26	.....	.....
27	.....	.....
28	.....	.....
29	.....	.....
30	.....	.....
31	.....	.....
32	.....	.....
33	.....	.....
34	.....	.....
35	.....	.....
36	.....	.....
37	.....	.....
38	.....	.....
39	.....	.....
40	.....	.....
41	.....	.....
42	.....	.....
43	.....	.....
44	.....	.....
45	.....	.....
46	.....	.....
47	.....	.....
48	.....	.....
49	.....	.....
50	.....	.....
51	.....	.....
52	.....	.....
53	.....	.....
54	.....	.....
55	.....	.....
56	.....	.....
57	.....	.....
58	.....	.....
59	.....	.....
60	.....	.....
61	.....	.....
62	.....	.....
63	.....	.....
64	.....	.....
65	.....	.....
66	.....	.....
67	.....	.....
68	.....	.....
69	.....	.....
70	.....	.....
71	.....	.....
72	.....	.....
73	.....	.....
74	.....	.....
75	.....	.....
76	.....	.....
77	.....	.....
78	.....	.....
79	.....	.....
80	.....	.....
81	.....	.....
82	.....	.....
83	.....	.....
84	.....	.....
85	.....	.....
86	.....	.....
87	.....	.....
88	.....	.....
89	.....	.....
90	.....	.....
91	.....	.....
92	.....	.....
93	.....	.....
94	.....	.....
95	.....	.....
96	.....	.....
97	.....	.....
98	.....	.....
99	.....	.....
100	.....	.....

DRAWINGS.

SOUTH ELEVATION

ELEVATION 33,000 VOLT BUS BARS

PLAN

SWITCHBOARD

SECTIONAL ELEVATION

OIL SWITCHES

SECTION GENERATOR ROOM

WIRING DIAGRAM

SECTION TURBINE ROOM

DETAIL OF BOILER AND SETTING

DETAIL OF 50 KW. TURBO-EXCITER

DETAILS OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX

SECTION OF 20 KW. TURBO-EX

SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX  
SECTION OF 20 KW. TURBO-EX

## PROJECT.

The design is to be of a water power plant of 1500 K. W. capacity with an equal auxiliary steam plant. This is to supply power to a 33,000 volt feeder, a 2,300 volt light and power feeder and a series arc circuit at Marseilles, Illinois. The ultimate capacity of the plant is to be 3,000 K.W.

## Local Conditions:

The plant is to be located on the Illinois river at Marseilles, where there is a dam providing a head of fourteen feet. Water from above the dam is diverted through two headraces and supplies power to a number of manufacturing plants. The new plant will be located on an extension of one of these headraces. Part of the concrete foundation has been constructed which limits the design to vertical type water wheels.

During the winter months, the water power is very uncertain and at times is altogether stopped, making the installation of an auxiliary plant a necessity.

## BUILDING.

The building is 140 feet long by 60 feet wide. A fire wall divides the boiler room which is 40 feet by 60 feet, from the remainder of the building. A separate foundation is provided for the generators and the boilers. The building foundation which also forms the retaining walls will support the other machinery.

The generator room is located over the spillway. There are three separate turbine pits divided by concrete walls which extend from the north end of the building to the condenser pits on the south end. These walls will support the water turbines and the turbo-generator sets with their condensers.







Support for a 15 ton crane will be provided by columns located in and forming part of the walls.

## TURBINES.

Sampson turbines of the vertical type are installed in two sets of three each. These walls have balanced wicket gates operated by the governor as shown in the plan view. A special harness supports the gears, line shaft and gate stems. By use of this continuous harness the alignment of the units is rigidly maintained. The wheels are connected to the generators by means of bevel gears. The following data shows the size and power of the wheels for a fourteen foot head.

74	inch diameter of runner
27040	cubic feet of water used per minute, per wheel.
54080	cubic feet of water used per minute, in each wheel pit.
5.1	feet per second equals velocity of water in wheel pits.
82	R.P.M. of wheel.
200	R. P.M. of generator
2.44:1	gear ratio.
580	D.H.P. of each wheel.
1740	D. H.P. of each set.
1570	H.P. available per line shaft assuming efficiency of gears equal 90%.
3140	H.P. total available.

Each line shaft will supply power to a 750 K.W. alternator and an oil pump for the governor. Power from either line shaft will also operate a 50 K. W. exciter.

The arrangement of the wheel pits is such that any pit can be closed as there are separate gates for each, thus cutting off one turbine from each shaft. This allows repairs to be made on the wheels without shutting down the plant or starting the auxiliary plant. When operating under this condition of two wheels per line shaft, the power ratings will be as follows:



1160	D.H.P. by two wheels.
1045	H.P. available per line shaft assuming the efficiency of the gears to be 90%.
2090	H.P. total available.

This will decrease the velocity of the water in the headrace but not in the wheel pits.

#### GENERATORS.

The generator installation consists of two 3-phase, 60 Cycle, 2,300 volt, 750 K.V., water wheel type Westinghouse alternators operating at 200 R.P.M. This machine has an efficiency of 92 per cent and a continuous overload capacity of 25 per cent. The power rating is as follows on unity power factor.

750	K.V.A. output / generator at normal full load.
815	K.V.A. input / generator at normal full load.
1090	H.P. input / generator at normal full load.
940	K.V.A. output / generator at 25% overload.
1260	H.P. output / generator at 25% overload.
1370	H.P. input / generator at 25% overload.
Total (Two alternators)	
1500	K.V.A. output at normal full load
2180	H.P. input at normal full load.
1880	K.V.A. output at 25% overload.
2740	H.P. input at 25% overload.

Allowing one hundred horsepower for the exciter and oil pumps there will be a total of 2840 H. P. required for a possible maximum. This leaves a margin of 300 H. P. which will allow for a slight reduction of head and will also give the governors more freedom of action.

1946  
1947  
1948  
1949  
1950  
1951  
1952  
1953  
1954  
1955  
1956  
1957  
1958  
1959  
1960  
1961  
1962  
1963  
1964  
1965  
1966  
1967  
1968  
1969  
1970  
1971  
1972  
1973  
1974  
1975  
1976  
1977  
1978  
1979  
1980  
1981  
1982  
1983  
1984  
1985  
1986  
1987  
1988  
1989  
1990  
1991  
1992  
1993  
1994  
1995  
1996  
1997  
1998  
1999  
2000  
2001  
2002  
2003  
2004  
2005  
2006  
2007  
2008  
2009  
2010  
2011  
2012  
2013  
2014  
2015  
2016  
2017  
2018  
2019  
2020  
2021  
2022  
2023  
2024  
2025  
2026  
2027  
2028  
2029  
2030  
2031  
2032  
2033  
2034  
2035  
2036  
2037  
2038  
2039  
2040  
2041  
2042  
2043  
2044  
2045  
2046  
2047  
2048  
2049  
2050  
2051  
2052  
2053  
2054  
2055  
2056  
2057  
2058  
2059  
2060  
2061  
2062  
2063  
2064  
2065  
2066  
2067  
2068  
2069  
2070  
2071  
2072  
2073  
2074  
2075  
2076  
2077  
2078  
2079  
2080  
2081  
2082  
2083  
2084  
2085  
2086  
2087  
2088  
2089  
2090  
2091  
2092  
2093  
2094  
2095  
2096  
2097  
2098  
2099  
2100  
2101  
2102  
2103  
2104  
2105  
2106  
2107  
2108  
2109  
2110  
2111  
2112  
2113  
2114  
2115  
2116  
2117  
2118  
2119  
2120  
2121  
2122  
2123  
2124  
2125  
2126  
2127  
2128  
2129  
2130  
2131  
2132  
2133  
2134  
2135  
2136  
2137  
2138  
2139  
2140  
2141  
2142  
2143  
2144  
2145  
2146  
2147  
2148  
2149  
2150  
2151  
2152  
2153  
2154  
2155  
2156  
2157  
2158  
2159  
2160  
2161  
2162  
2163  
2164  
2165  
2166  
2167  
2168  
2169  
2170  
2171  
2172  
2173  
2174  
2175  
2176  
2177  
2178  
2179  
2180  
2181  
2182  
2183  
2184  
2185  
2186  
2187  
2188  
2189  
2190  
2191  
2192  
2193  
2194  
2195  
2196  
2197  
2198  
2199  
2200  
2201  
2202  
2203  
2204  
2205  
2206  
2207  
2208  
2209  
2210  
2211  
2212  
2213  
2214  
2215  
2216  
2217  
2218  
2219  
2220  
2221  
2222  
2223  
2224  
2225  
2226  
2227  
2228  
2229  
2230  
2231  
2232  
2233  
2234  
2235  
2236  
2237  
2238  
2239  
2240  
2241  
2242  
2243  
2244  
2245  
2246  
2247  
2248  
2249  
2250  
2251  
2252  
2253  
2254  
2255  
2256  
2257  
2258  
2259  
2260  
2261  
2262  
2263  
2264  
2265  
2266  
2267  
2268  
2269  
2270  
2271  
2272  
2273  
2274  
2275  
2276  
2277  
2278  
2279  
2280  
2281  
2282  
2283  
2284  
2285  
2286  
2287  
2288  
2289  
2290  
2291  
2292  
2293  
2294  
2295  
2296  
2297  
2298  
2299  
2300  
2301  
2302  
2303  
2304  
2305  
2306  
2307  
2308  
2309  
2310  
2311  
2312  
2313  
2314  
2315  
2316  
2317  
2318  
2319  
2320  
2321  
2322  
2323  
2324  
2325  
2326  
2327  
2328  
2329  
2330  
2331  
2332  
2333  
2334  
2335  
2336  
2337  
2338  
2339  
2340  
2341  
2342  
2343  
2344  
2345  
2346  
2347  
2348  
2349  
2350  
2351  
2352  
2353  
2354  
2355  
2356  
2357  
2358  
2359  
2360  
2361  
2362  
2363  
2364  
2365  
2366  
2367  
2368  
2369  
2370  
2371  
2372  
2373  
2374  
2375  
2376  
2377  
2378  
2379  
2380  
2381  
2382  
2383  
2384  
2385  
2386  
2387  
2388  
2389  
2390  
2391  
2392  
2393  
2394  
2395  
2396  
2397  
2398  
2399  
2400  
2401  
2402  
2403  
2404  
2405  
2406  
2407  
2408  
2409  
2410  
2411  
2412  
2413  
2414  
2415  
2416  
2417  
2418  
2419  
2420  
2421  
2422  
2423  
2424  
2425  
2426  
2427  
2428  
2429  
2430  
2431  
2432  
2433  
2434  
2435  
2436  
2437  
2438  
2439  
2440  
2441  
2442  
2443  
2444  
2445  
2446  
2447  
2448  
2449  
2450  
2451  
2452  
2453  
2454  
2455  
2456  
2457  
2458  
2459  
2460  
2461  
2462  
2463  
2464  
2465  
2466  
2467  
2468  
2469  
2470  
2471  
2472  
2473  
2474  
2475  
2476  
2477  
2478  
2479  
2480  
2481  
2482  
2483  
2484  
2485  
2486  
2487  
2488  
2489  
2490  
2491  
2492  
2493  
2494  
2495  
2496  
2497  
2498  
2499  
2500  
2501  
2502  
2503  
2504  
2505  
2506  
2507  
2508  
2509  
2510  
2511  
2512  
2513  
2514  
2515  
2516  
2517  
2518  
2519  
2520  
2521  
2522  
2523  
2524  
2525  
2526  
2527  
2528  
2529  
2530  
2531  
2532  
2533  
2534  
2535  
2536  
2537  
2538  
2539  
2540  
2541  
2542  
2543  
2544  
2545  
2546  
2547  
2548  
2549  
2550  
2551  
2552  
2553  
2554  
2555  
2556  
2557  
2558  
2559  
2560  
2561  
2562  
2563  
2564  
2565  
2566  
2567  
2568  
2569  
2570  
2571  
2572  
2573  
2574  
2575  
2576  
2577  
2578  
2579  
2580  
2581  
2582  
2583  
2584  
2585  
2586  
2587  
2588  
2589  
2590  
2591  
2592  
2593  
2594  
2595  
2596  
2597  
2598  
2599  
2600  
2601  
2602  
2603  
2604  
2605  
2606  
2607  
2608  
2609  
2610  
2611  
2612  
2613  
2614  
2615  
2616  
2617  
2618  
2619  
2620  
2621  
2622  
2623  
2624  
2625  
2626  
2627  
26

1. The first step is to identify the problem or question that needs to be answered. This involves understanding the context and the specific requirements of the task.

• FACTORS

[illegible]



## EXCITERS.

The excitation for the alternators is supplied at 125 volts from any of three separate units, each of 50 K. W. capacity. One unit is belt driven from either of the main shafts at 850 R. P. M. When operating by steam, the excitation is supplied from a 50 K. W. turbo-generator set, run noncondensing. A 50 K. W. Westing house motor-generator set is installed as a reserve unit.

## AUXILIARY MACHINERY.

Lombard Type "N" governors are used for regulating the turbine speed. In this type of governor, the oil pump, tanks and governor proper can be separated which allows a more suitable arrangement to be made.

The 33,000 volt line is supplied from three single phase, 400 K. W., oil cooled Westinghouse transformers connected in delta on both; the primary and secondary side. The ratio of transformation is 2,300 to 33,000 volts. The transformer bank is connected to the bus bars by means of a Westinghouse type "B" manually operated non-automatic oil circuit breaker. The secondary is connected to the line by means of a Westinghouse type "C" solenoid operated automatic oil circuit breaker. Choke coils in conjunction with electrolytic cell lightning arresters protects the station apparatus from outside disturbances.

The arc light circuit is supplied from a 50 light capacity constant current regulators. Oil switches are used on the panel which is separate from the main board. The primary switch is double pole and double throw, so that the arc load can be placed on either of two phases.

## SWITCHBOARD.

The switchboard is 95 inches high, and 16 feet 6 inches in length, and follows the Westinghouse practice. The oil switches, bus bars, and instrument transformers are placed on a separate structure away from the board. The field rheostats are remote controlled and are placed on the wall above the bus bars. All oil switches are manually operated excepting the 33,000 volt switch which is solenoid operated. The arc light panel is placed near the



constant current regulator as the 2,300 volt wires are brought direct to the back of the panel. All wiring is in conduit excepting 33,000 volt wires. Following is a list of the switchboard instruments.

#### Generator Panels. (Four)

- 1 type F A.c. ammeter.
- 1 type F polyphase wattmeter.
- 1 type D field ammeter.
- 1 ammeter receptacle.
- 1 voltmeter receptacle.
- 1 synchronizing receptacle and lamp.
- 1 field switch with discharge attachment.
- 1 field rheostat.
- 1 type B non-automatic oil circuit breaker.

#### Single Exciter Panel.

- 1 type K d.c. ammeter.
- 1 field rheostat.
- 1 type D d.p.s.t. knife switch.

#### Double Exciter Panel.

- 2 type K d.c. ammeter.
- 1 type K d.c. voltmeter.
- 1 eight point voltmeter receptacle.
- 2 field rheostats.
- 2 type D d.p.s.t. knife switch.

#### Regulator Panel.

- 1 type T A-125 voltage regulator.
- 2 type D d.p.d.t. knife switches.

#### Feeder Panel (2,300 volts)

- 3 type I a.c. Ammeters.
- 1 type polyphase wattmeter.
- 1 type B automatic oil circuit breaker.
- 1 type I a.c. ammeter (station lights)
- 1 type B automatic oil circuit breaker (station lights)

#### Feeder Panel (33,000(volts)

- 3 type I a.c. ammeters.
- 1 type I polyphase wattmeter.
- 1 type B non-automatic oil circuit breaker.

The following is a list of the specimens collected during the expedition to the ...  
 and the ... of the ...  
 ...

Specimens collected. (1900)

- 1 Type 1. ...
- 1 Type 2. ...
- 1 Type 3. ...
- 1 Type 4. ...
- 1 Type 5. ...
- 1 Type 6. ...
- 1 Type 7. ...
- 1 Type 8. ...
- 1 Type 9. ...
- 1 Type 10. ...

Specimens collected. (1901)

- 1 Type 1. ...
- 1 Type 2. ...
- 1 Type 3. ...

Specimens collected. (1902)

- 1 Type 1. ...
- 1 Type 2. ...
- 1 Type 3. ...
- 1 Type 4. ...
- 1 Type 5. ...
- 1 Type 6. ...

Specimens collected. (1903)

- 1 Type 1. ...
- 1 Type 2. ...

Specimens collected. (1904)

- 1 Type 1. ...
- 1 Type 2. ...
- 1 Type 3. ...
- 1 Type 4. ...
- 1 Type 5. ...
- 1 Type 6. ...
- 1 Type 7. ...
- 1 Type 8. ...
- 1 Type 9. ...
- 1 Type 10. ...

Specimens collected. (1905)

- 1 Type 1. ...
- 1 Type 2. ...
- 1 Type 3. ...



- 1 controlling switch for 33,000 volt type C automatic oil circuit breaker.

indicating lights.

#### Arc Light Panel.

- 1 type F a.c. ammeter.
- 1 type D d.p.d.t. oil switch.
- 1 type D combination d.p.s.t. and s.p.s.t. oil switch.



## AUXILIARY STEAM PLANT.

The steam plant duplicates the water power plant in capacity.

### BOILERS.

The boiler plant consists of three 315 H. P. type "S" Sterling boilers fitted with Green chain grates and operating at 150 pounds pressure. Two of the boilers are in a twin setting and the third setting joins the fire wall between the turbine room and the boiler room. The stokers are operated by a Wachs disc crank engine which exhausts into the main exhaust header.

Coal is dumped directly from cars onto the boiler room floor, through windows in the north wall. No bunkers nor downspouts are used.

A detail of the boiler, its setting, grate and foundation is shown in an accompanying drawing.

### MECHANICAL DRAFT.

An induced draft system is installed, owing to the cost and the necessity of overload capacity. The blower is manufactured by the American Blower Company and is full housed, top vertical discharge, steel plate fan. The wheel has a diameter of 108 inches and a width of 42 inches. At 250 R. P. M. the fan will discharge 77,000 cubic feet of flue gas per minute at 550° F giving about one ounce per square inch draft. Under these conditions about 30 B. H. P. is required.

The blower is operated by a 9"x8" American Blower Company vertical, enclosed self oiling engine fitted with an outboard bearing on which the fan wheel is supported. This engine exhausts into the main exhaust header.

# ALUMINUM PLANT

The plant is located in the town of...

2012-12-12

The plant consists of three main parts: a boiler room, a turbine room, and a condenser room. The boiler room is located on the first floor and contains two large boilers. The turbine room is located on the second floor and contains a large turbine. The condenser room is located on the third floor and contains a large condenser. The plant is operated by a single operator who controls the entire system from a central control room.

Coal is shipped directly from the mine to the boiler room floor, through a series of chutes and elevators. The plant is designed to operate continuously for 24 hours a day.

A detail of the boiler, its various parts, and its operation is shown in the accompanying drawings.

2012-12-12

The plant is designed to produce 100,000 kilowatts of power. It is capable of operating at a pressure of 1,000 pounds per square inch. The plant is equipped with a large storage tank for water and a large storage tank for coal. The plant is also equipped with a large storage tank for oil. The plant is designed to be able to operate on either coal or oil.

The plant is operated by a single operator who controls the entire system from a central control room. The operator is able to adjust the pressure, temperature, and flow rate of the water and coal. The operator is also able to shut down the plant in the event of an emergency.

## PUMPS.

Two Mareh steam pumps are installed; a 6"x 8"x 12" low service pump supplying cold water to the feed water heater, and a 12"x 8"x 12" boiler feed pump taking water from the heater or directly from the main supply and discharging to the boiler feed line. The pumps each have a capacity of 15,600 gallons per hour with discharge pressures of 30 and 150 pounds per square inch respectively, and a maximum back pressure of 2 pounds per square inch.

## FEED WATER HEATER.

A Water open feedwater heater of 1000 H.P. rating is installed. It is piped so that all or a part only of the exhaust steam may be passed through it. The heater is of the vertical, cylindrical, boiler iron type, not a cast heater. It is supplied with a 10 inch exhaust steam oil separator, and has the usual cleaning doors, water level regulating devices and other appurtenances common to the open type of heater.

Exhaust steam is supplied from all of the steam using apparatus with the exception of the two 750 K. W. turbo-generator sets.

## TURBO-GENERATORS.

The steam generating apparatus consists of two 750 K. W. Westinghouse Parsons turbo-generators, running at 3,600 R. P. M. and furnishing 3-phase alternating current at 2,300 volts. The two units are placed along the south wall of the wheel room. This allows space for condenser pits below the turbines without obstructing the head race. The turbines are supported by six 15 inch I-beams which are in turn supported by 24 inch I-beams and the south retaining wall. The 24 inch I-Beams are supported on extensions of the wheel pit walls.





The exciter turbine is operated non-condensing, the exhaust being run to the main exhaust header and from thence to the feed water heater or the free exhaust as conditions demand.

#### CONDENSERS.

The condensing apparatus consists of two No. 7 Westinghouse Leblanc condensers. They are each capable of handling from 20,000 to 25,000 pounds of steam per hour with the cooling water at 70° F and will maintain a vacuum of 28 inches or better under such conditions.

This type of condenser is really a barometric condenser in which the tail pipe is replaced by a centrifugal pump. The air is taken out by a rotary or centrifugal air pump using water slugs as pistons. These slugs are shot down through an injector tube and carry the air in front of them. The base discharge pump (tail pipe pump) and the air pump are mounted together on a horizontal shaft, and form part of the base of the condenser. They are driven by a non-condensing steam turbine, exhausting to the main exhaust header.

The cooling water and air pump water are taken directly from the tail race through 9 inch and 6 inch lines respectively, each being fitted with ample sized strainers. The pumps discharge through pipes in the south retaining wall into the river. The free or atmospheric exhaust is also run through the south retaining wall.





## STEAM PIPING.

A 7 inch line runs from each boiler to a 14 inch header, the spider system and the resulting short header being used. Each boiler lead has a non-return valve and a straightway or gate valve. The 14 inch header is not anchored but is simply placed on a pair of rollers on the back of boiler No. 1. From this main header there are two main leads and a small lead to the stoker engine. The 750 K. W. turbines are supplied through an 8 inch steam line, tapering off to 6 inch line. This is a high velocity main. The second lead runs to a 5 inch auxilliary header on the south wall which supplies steam through a 3 inch lead to the condenser pump turbines, through a 3 inch lead to the blower engine, and through 1 inch and 3/4 inch pipes to the 12"x 8"x 12" and the 6"x 8"x 12" steam pumps. A lateral in the line from the main to the auxil iary header supplies steam to the exciter turbine. The details of the above are shown on an accompanying drawing.

## EXHAUST PIPING.

A main header 10 inches in diameter has leads from the auxiliaries as follows: 6 inch lead from exciter turbine; 7 inch lead from condenser pump turbines; 3 1/2 inch lead from blower engine; 1 1/2 inch and 1 inch lead from the pumps and a 1 inch lead from the stoker engine.. A 10 inch vertical exhaust pipe runs from this header to the atmosphere through a back pressure valve.



Through valves are used in conjunction with this exhaust pipe and the feed water heater so that the heater's supply of exhaust steam may be regulated to suit the conditions.


Details of the above may be found in an accompanying drawing.










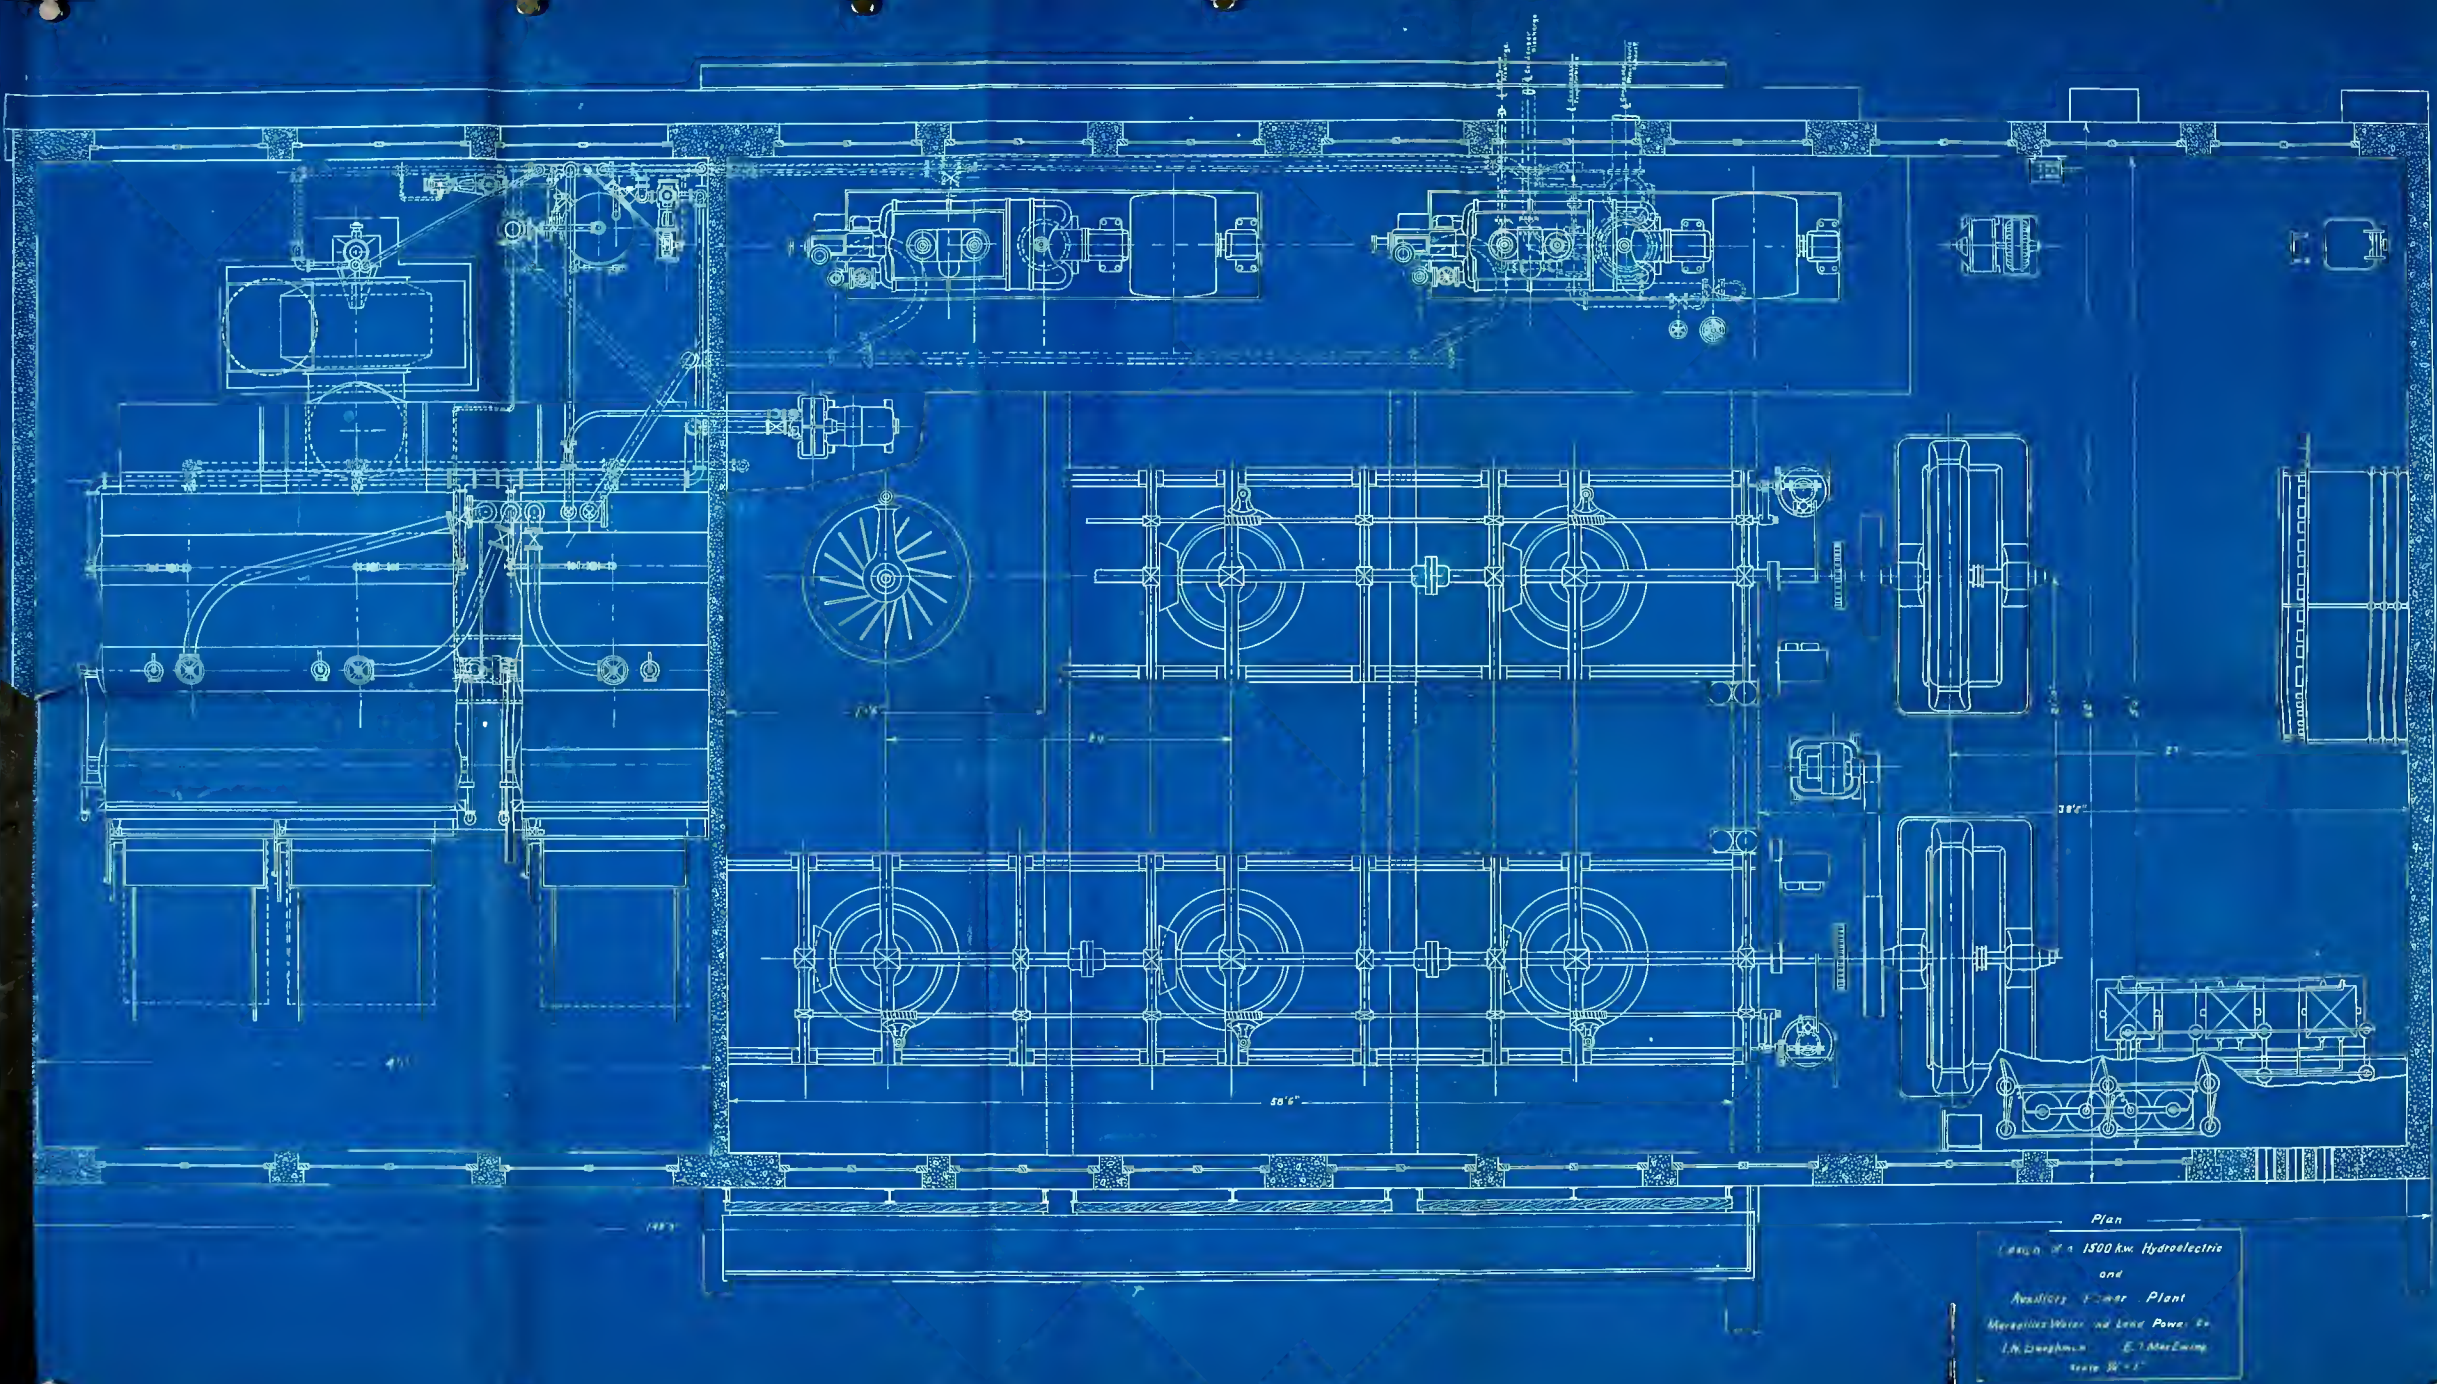



Plan  
of a 1500 kw. Hydroelectric  
and  
Auxiliary Power Plant  
Municipal Water and Power Co.  
J. H. Doughton E. J. MacEwing  
Scale 3/4" = 1'

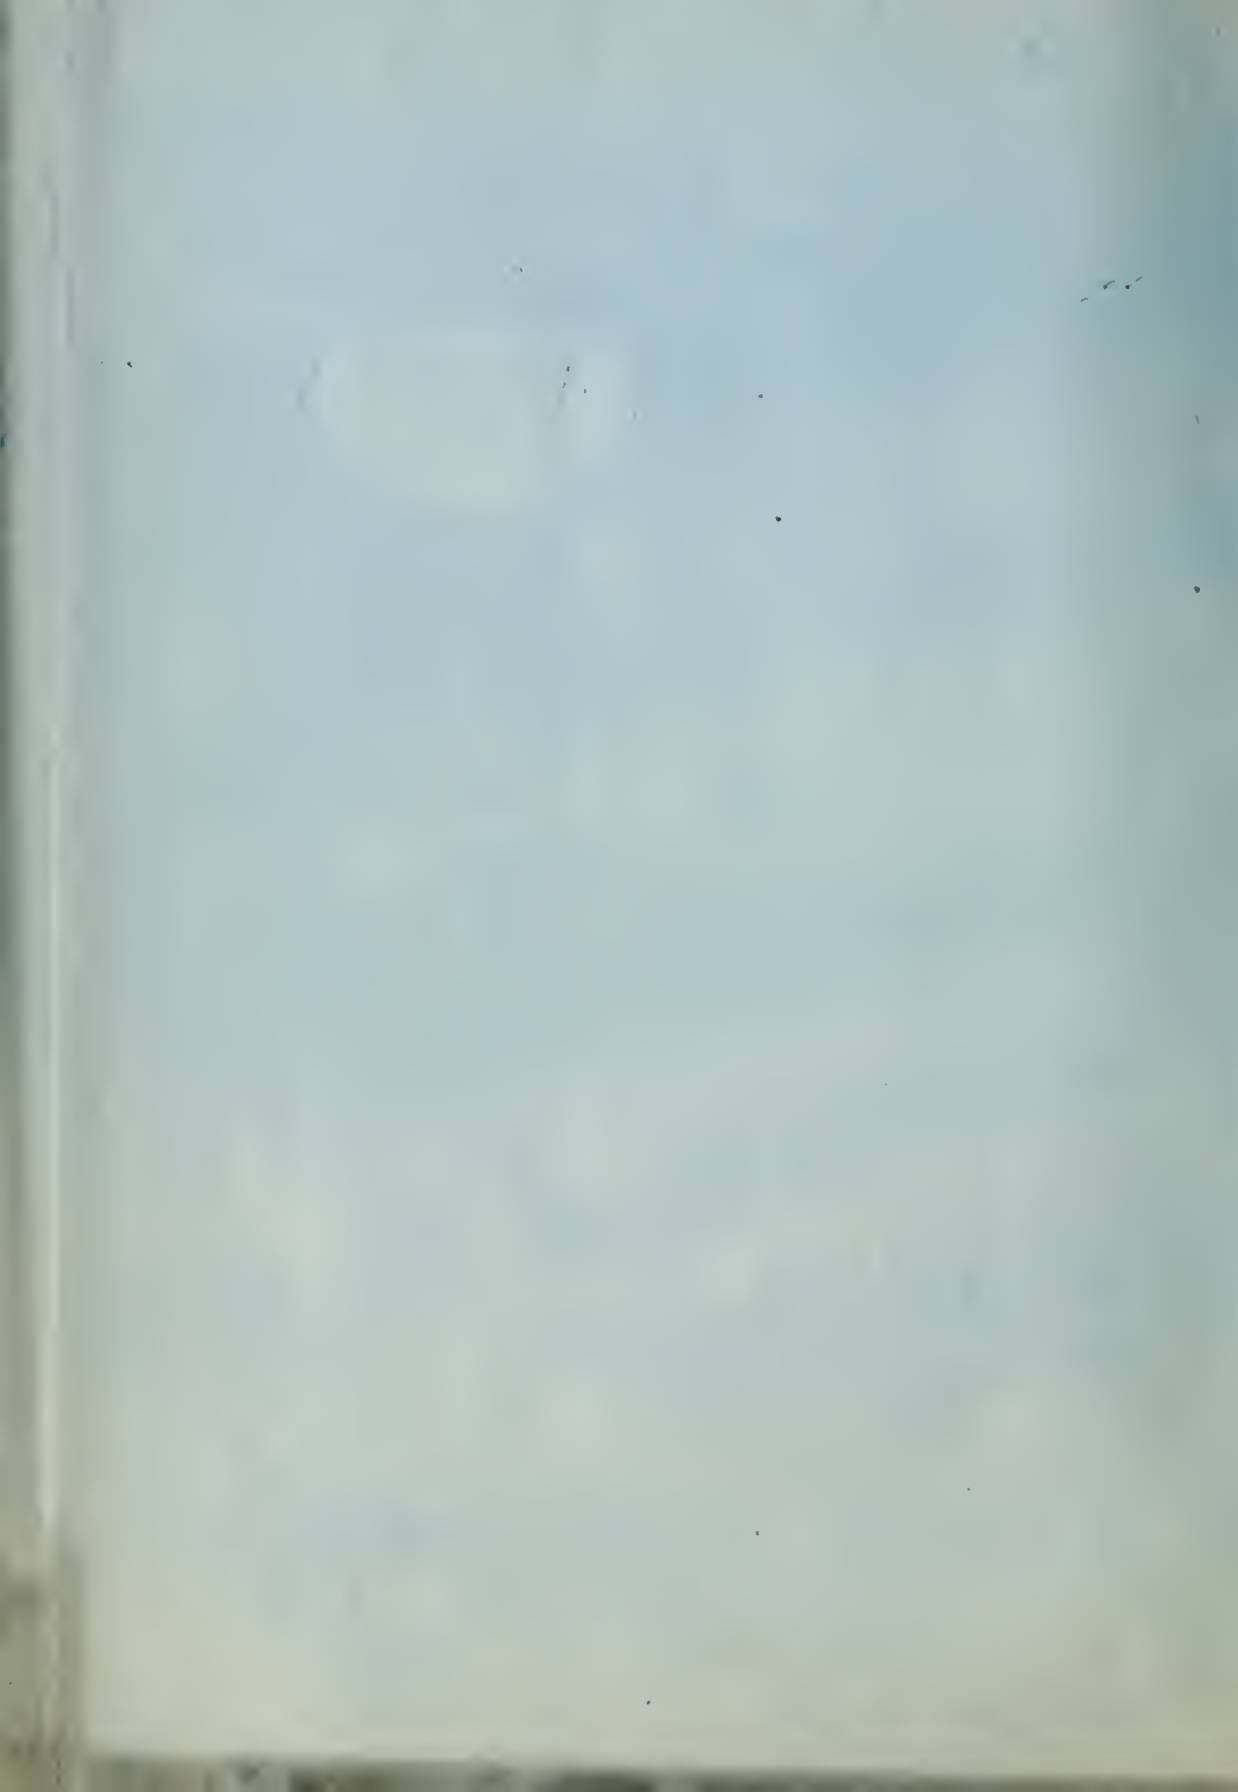





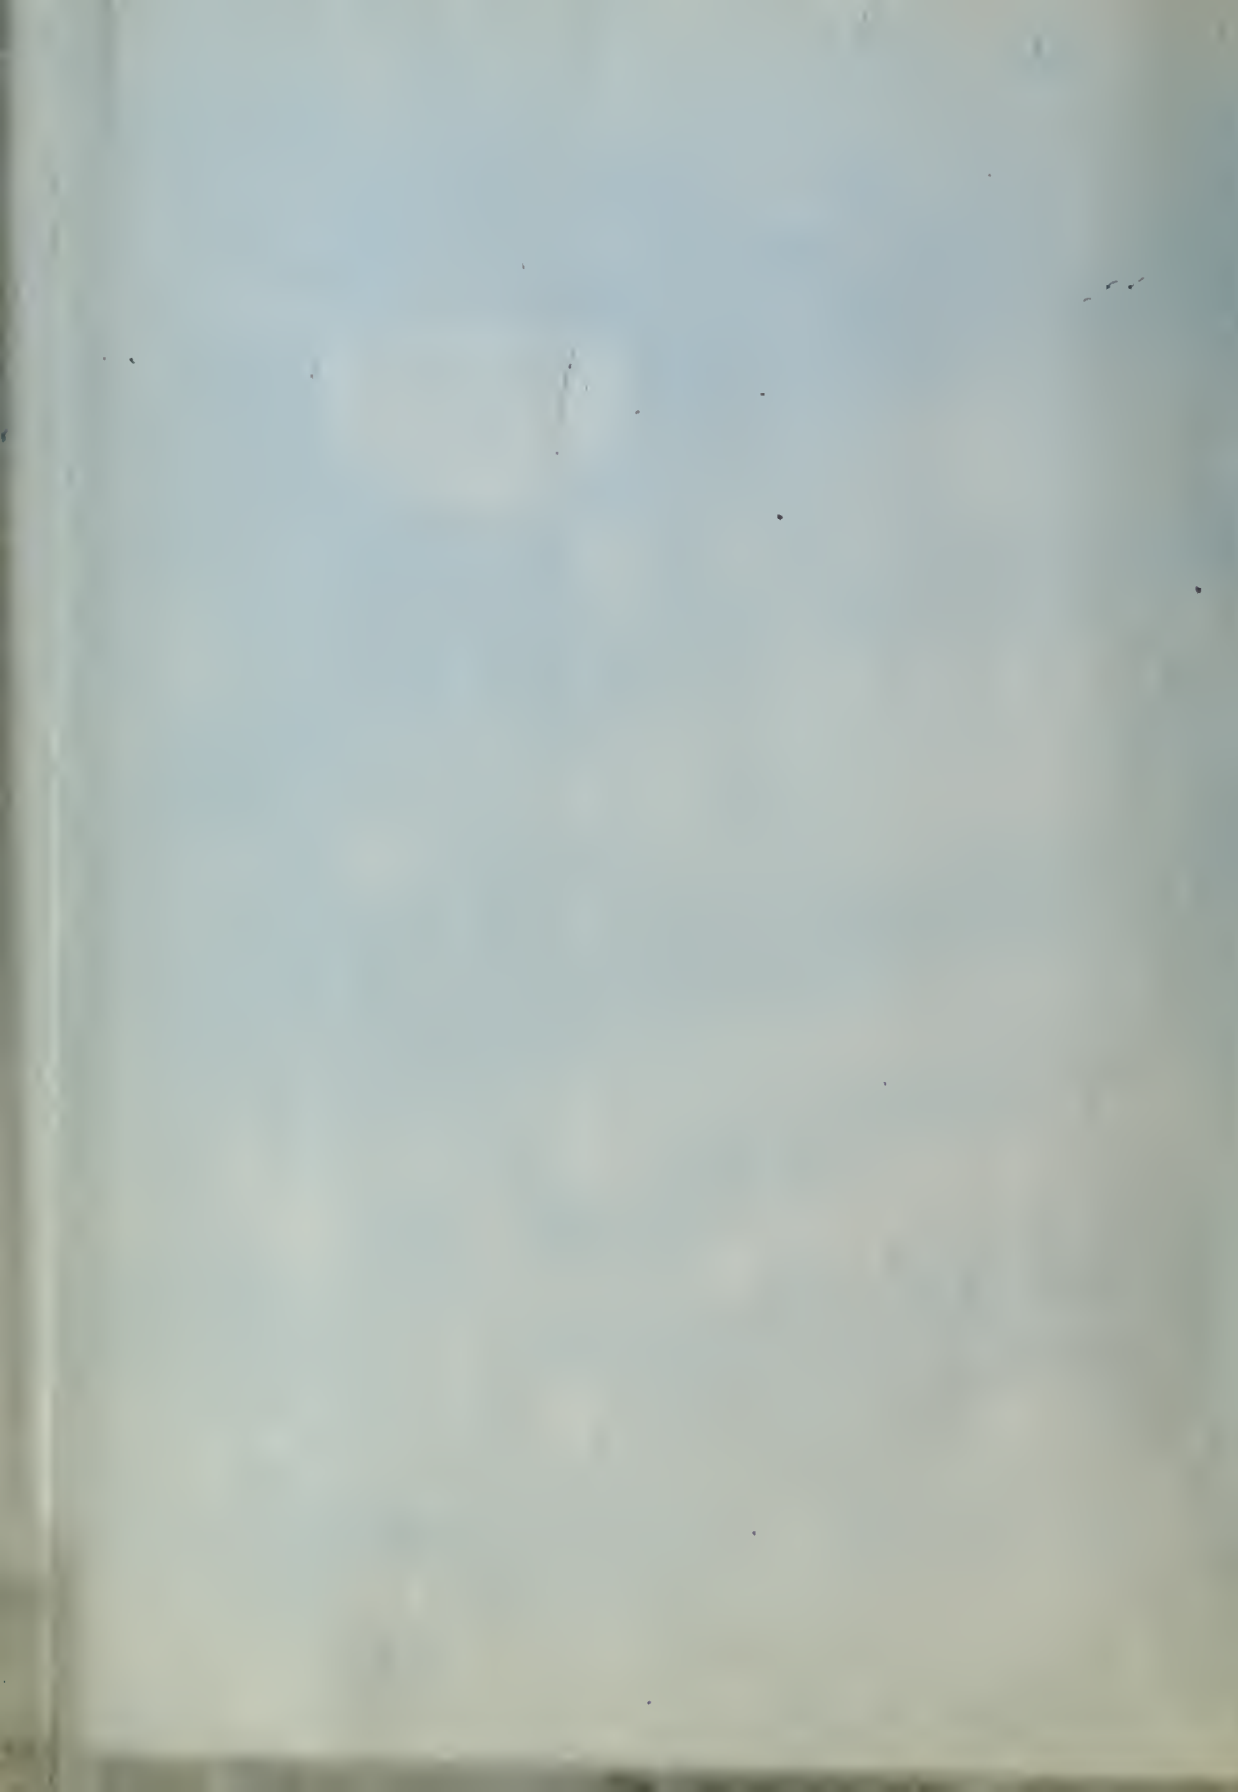

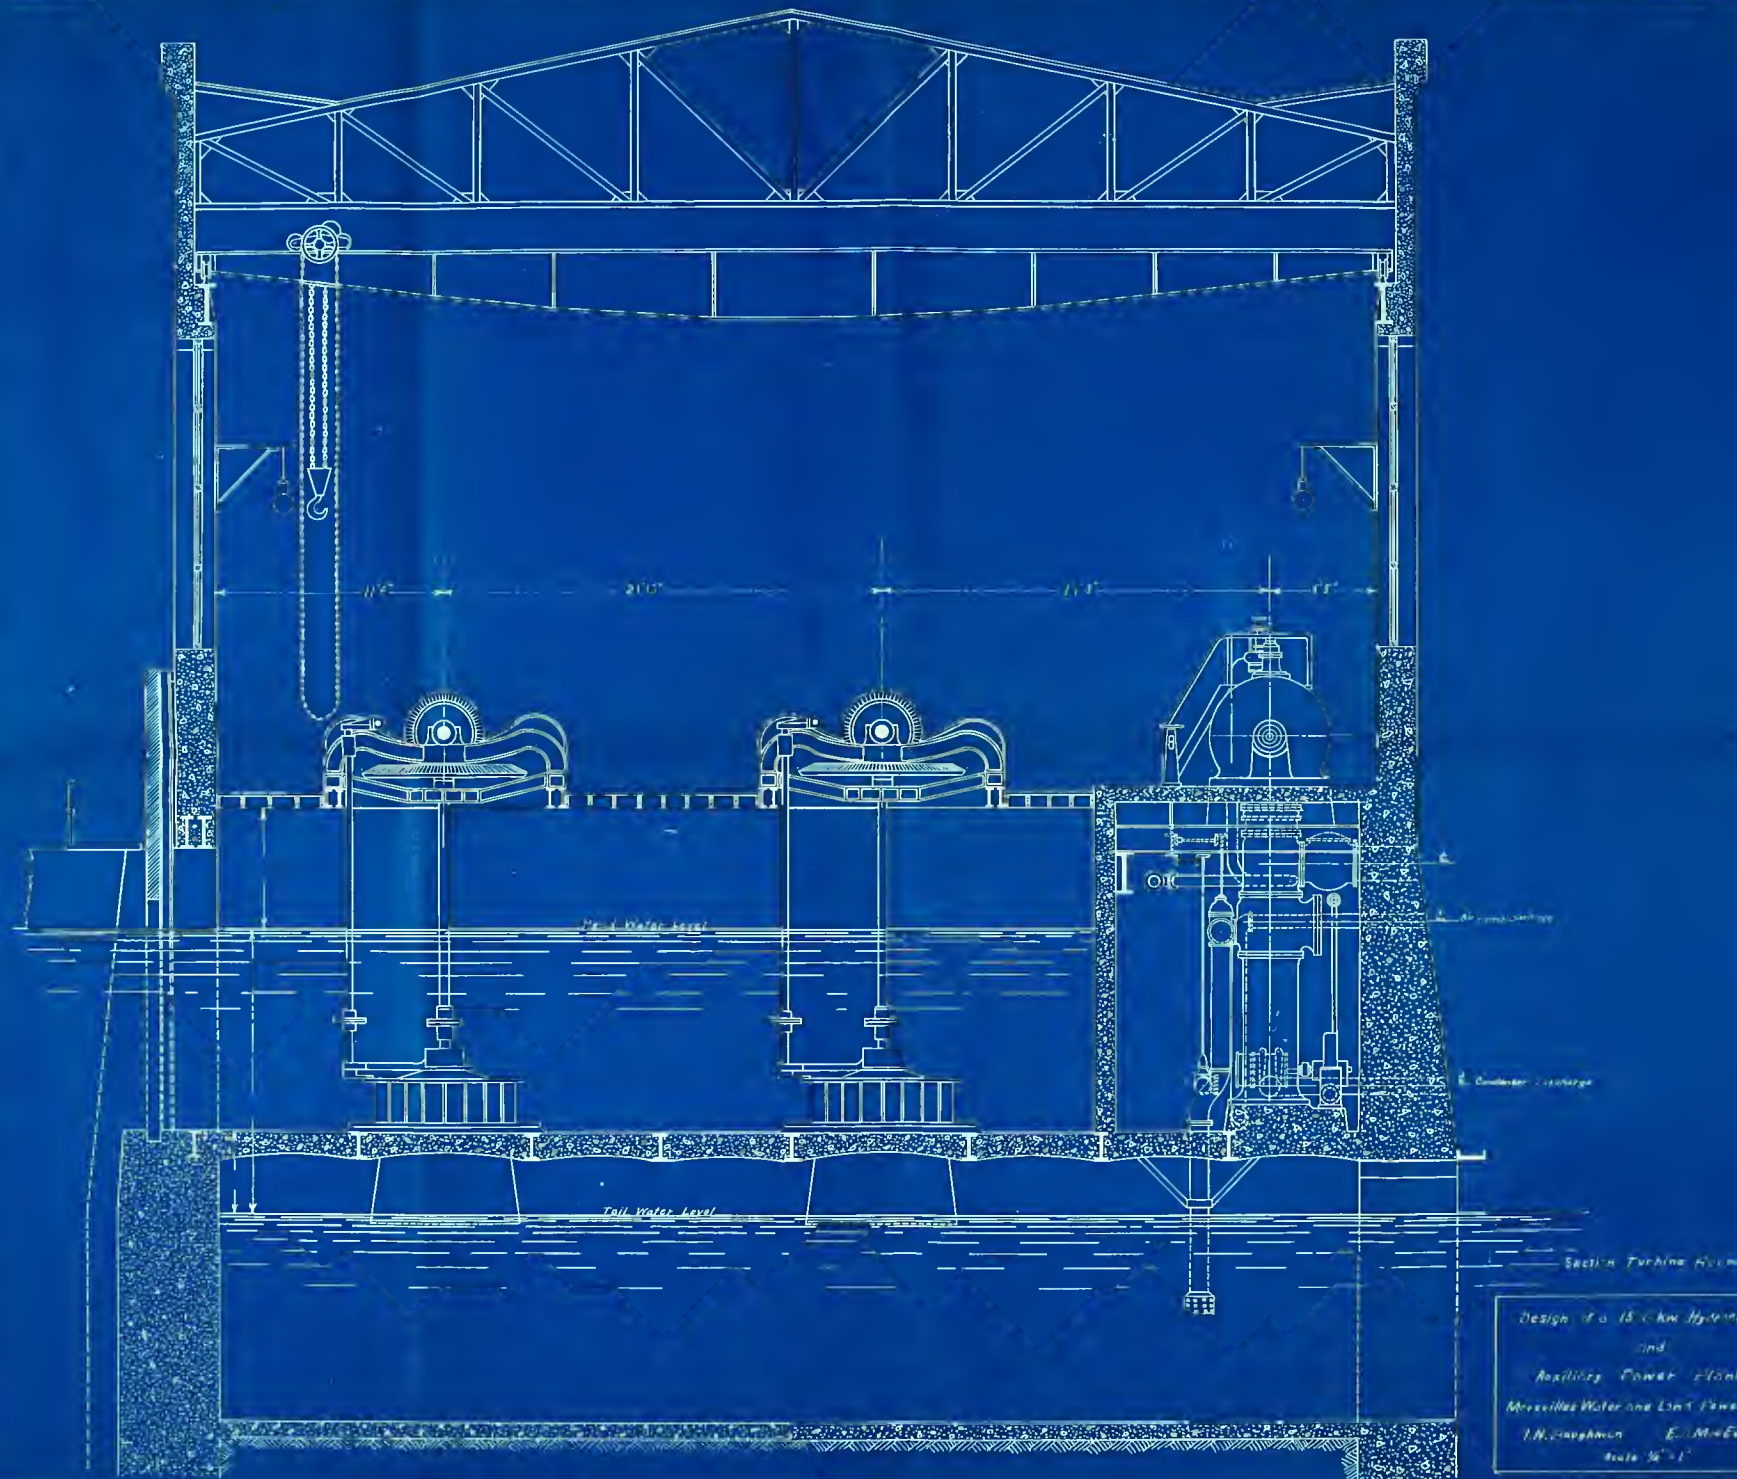

Section Furnace Room

Design of a 18,000 H.P. Hydroelectric  
and  
Auxiliary Power Plant  
Missoula Water and Light Power Co.  
J. M. Laughlin E. M. Ewing  
Scale 3/8" = 1'



200 mm. 18000  
Regulator

200 mm. 18000  
Station Lights


200 mm. 18000  
Feeder

M. Baughman

E.D. MacEwing





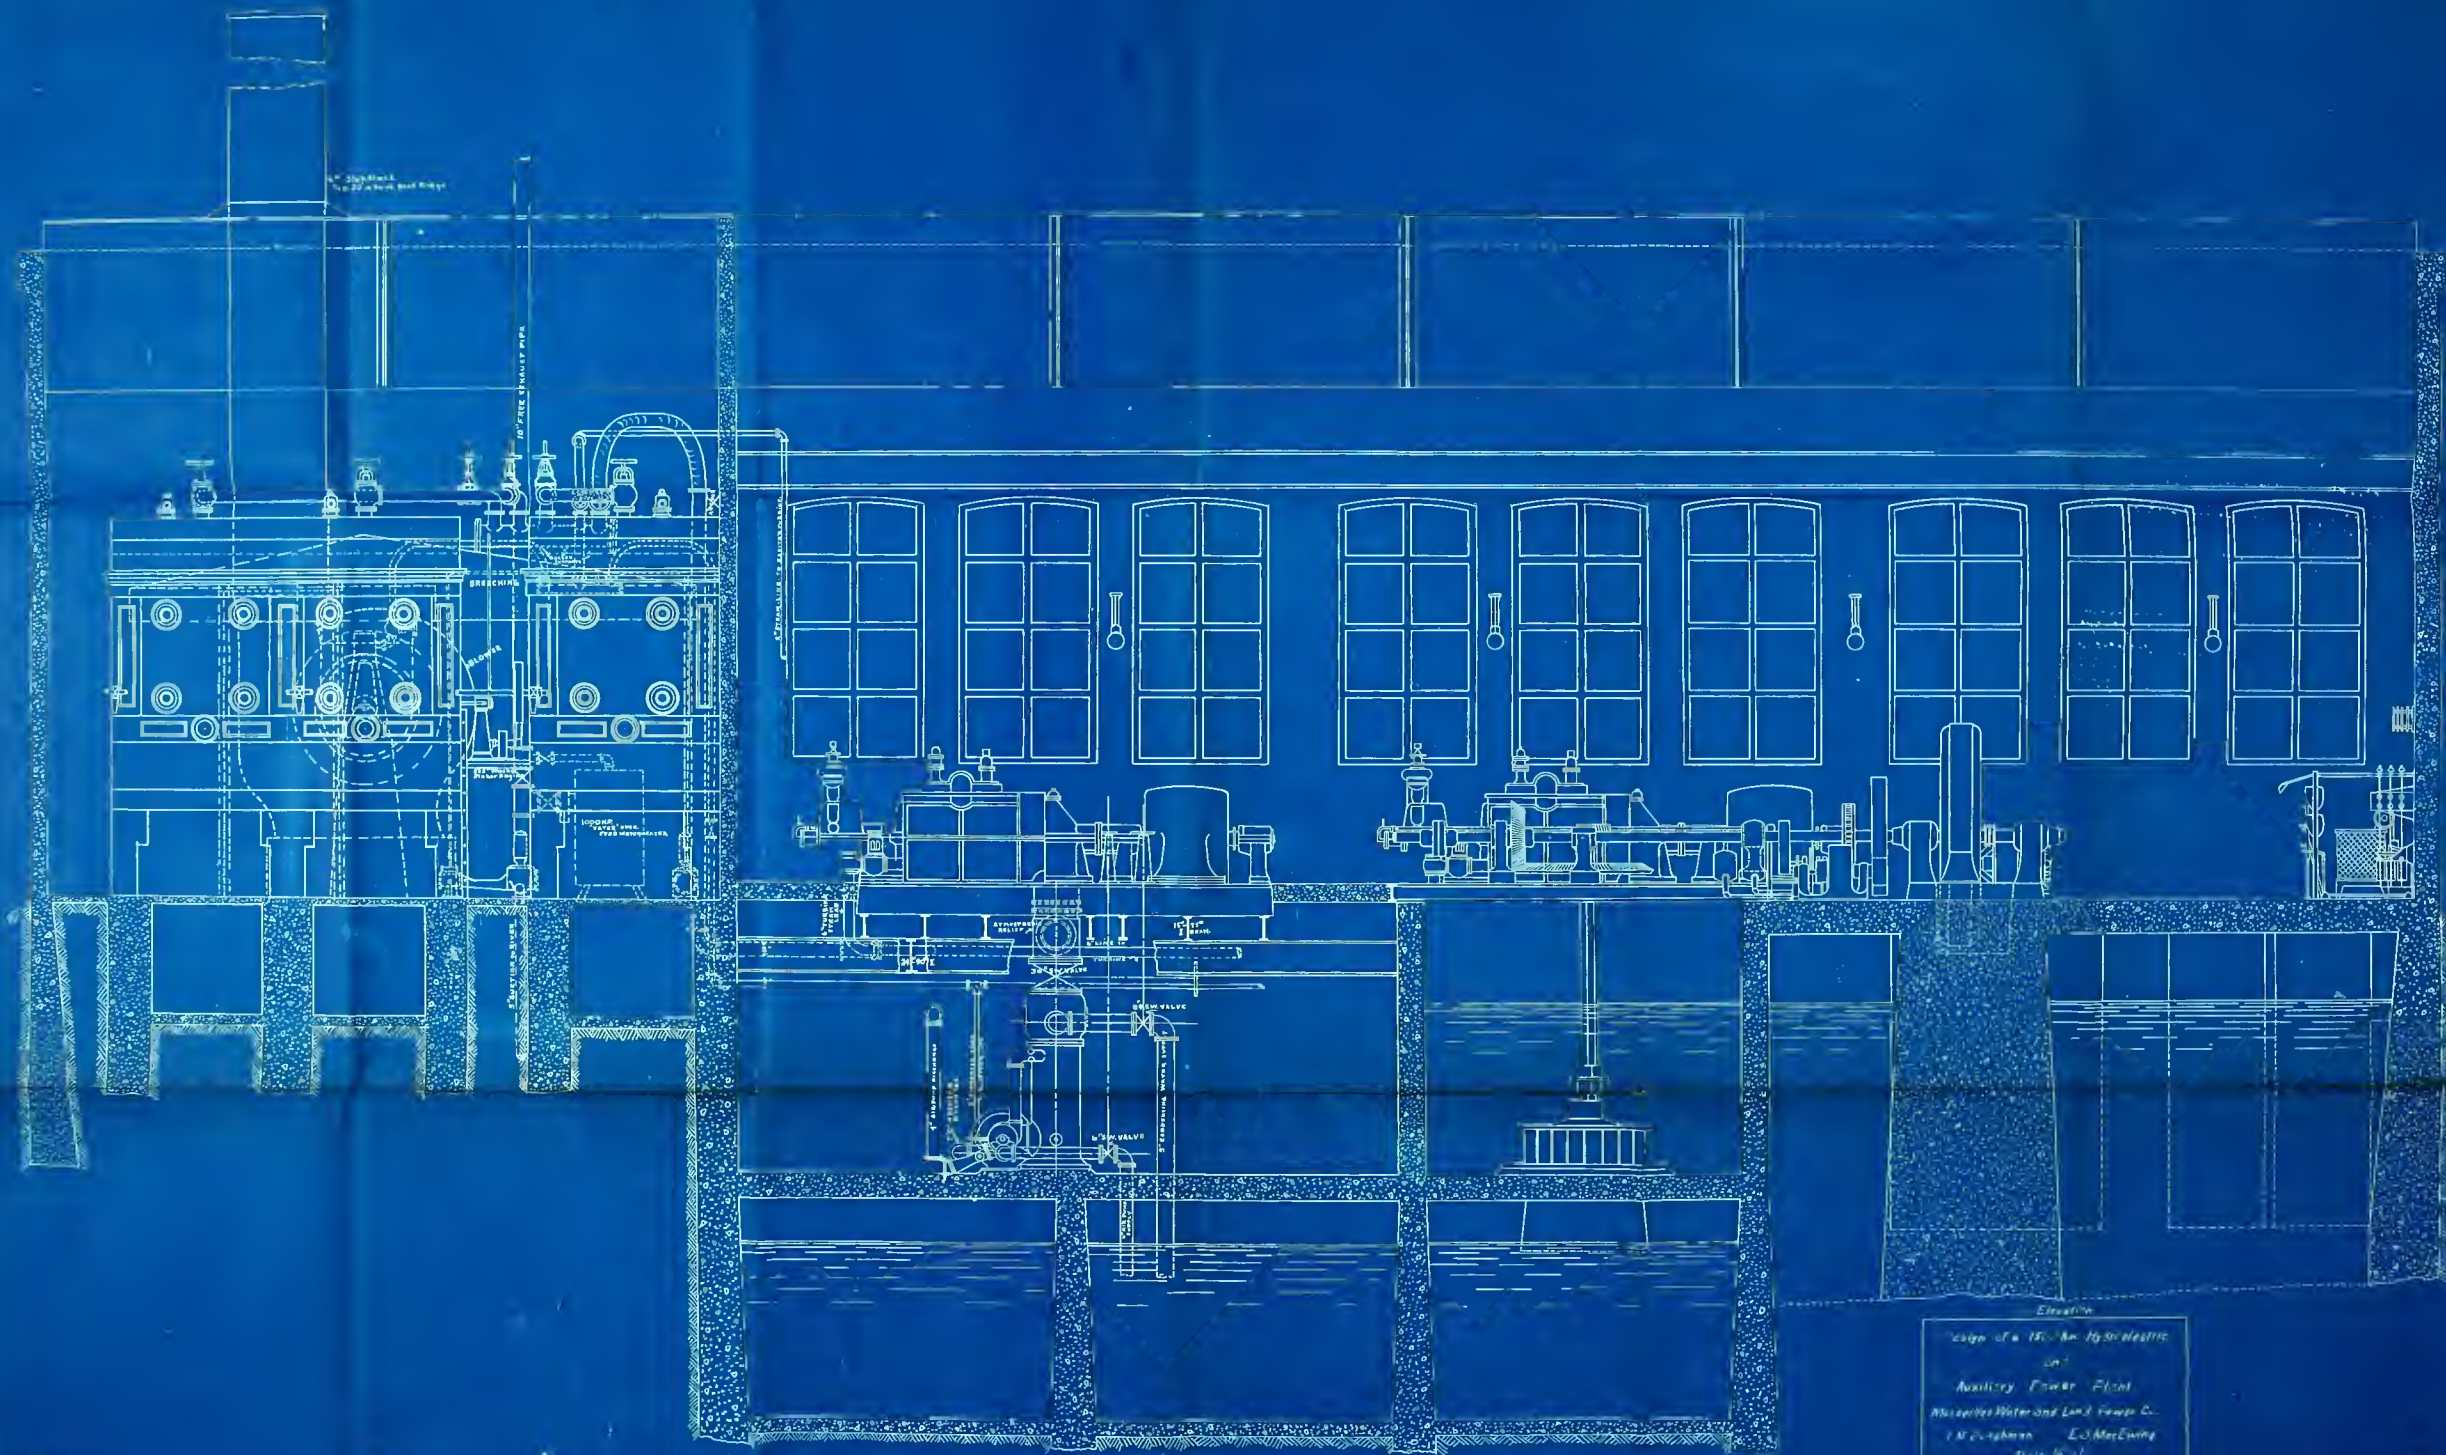

Elevation  
 of a 1500 H.P. Hydraulic  
 Plant  
 Auxiliary Power Plant  
 Mississippi Water and Land Reclamation Co.  
 J. H. Loughman L. J. MacEwen  
 June 1911





Regulator


200 AM Feeder  
Station Lights

Feeder

M. Baughman

E.D. MacSwing



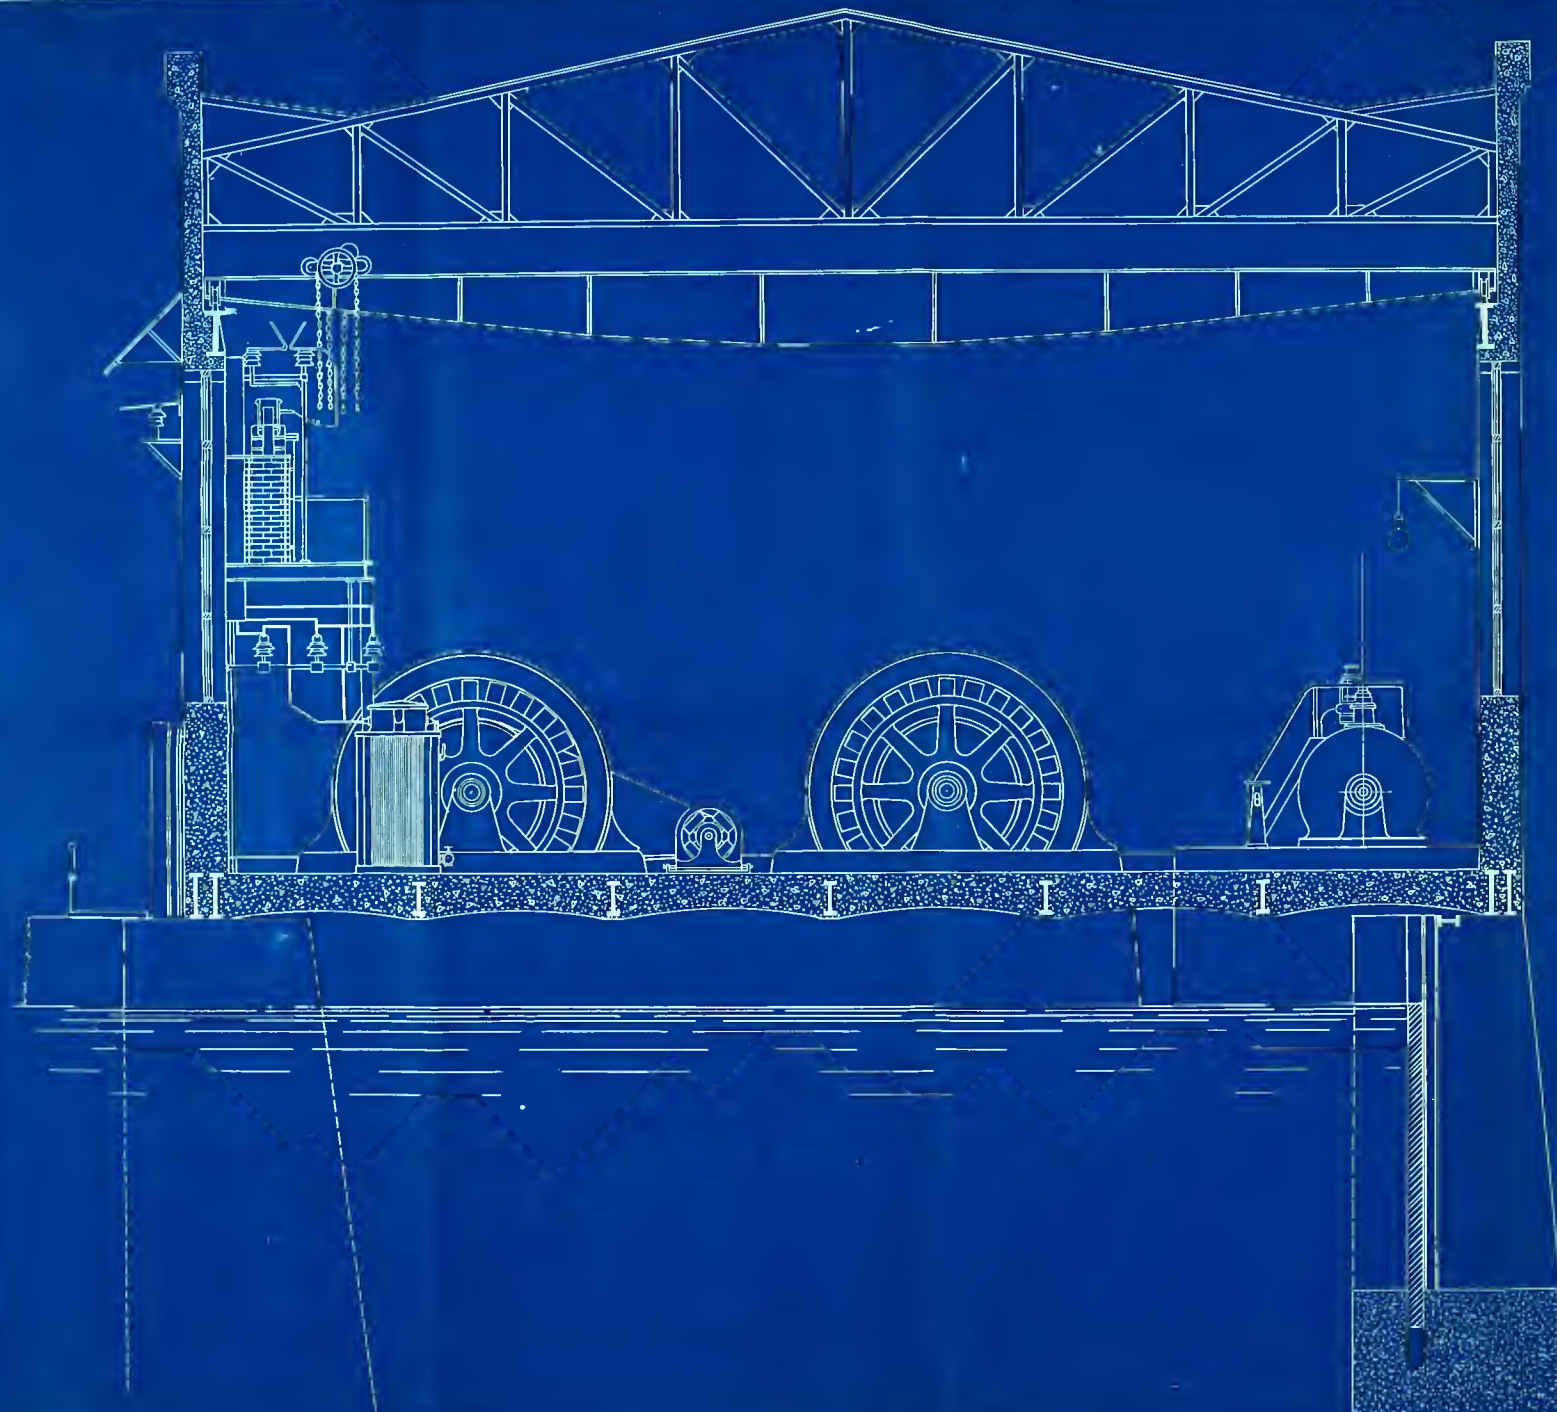


Section Generator Room

Design of a 1500 Kw Hydroelectric  
and  
Auxiliary Power Plant  
Missville Water and Land Power Co.  
J.N. Buchanan E.D. McEwing  
Scale 1/4" = 1'





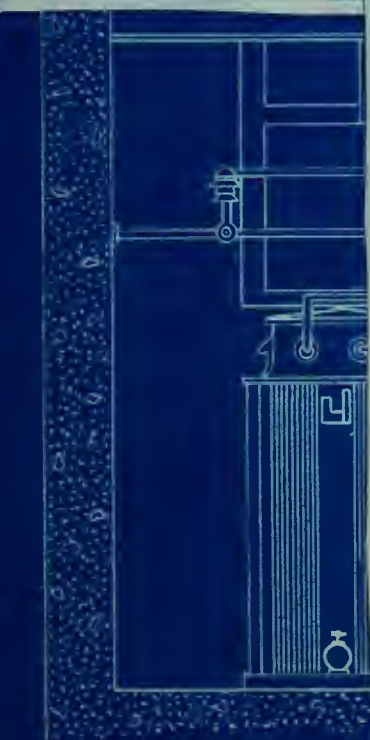

30. Regulator

200 N.W. Feeder  
Station Lights


Feeder

W. Baughman

E.D. MacEwing






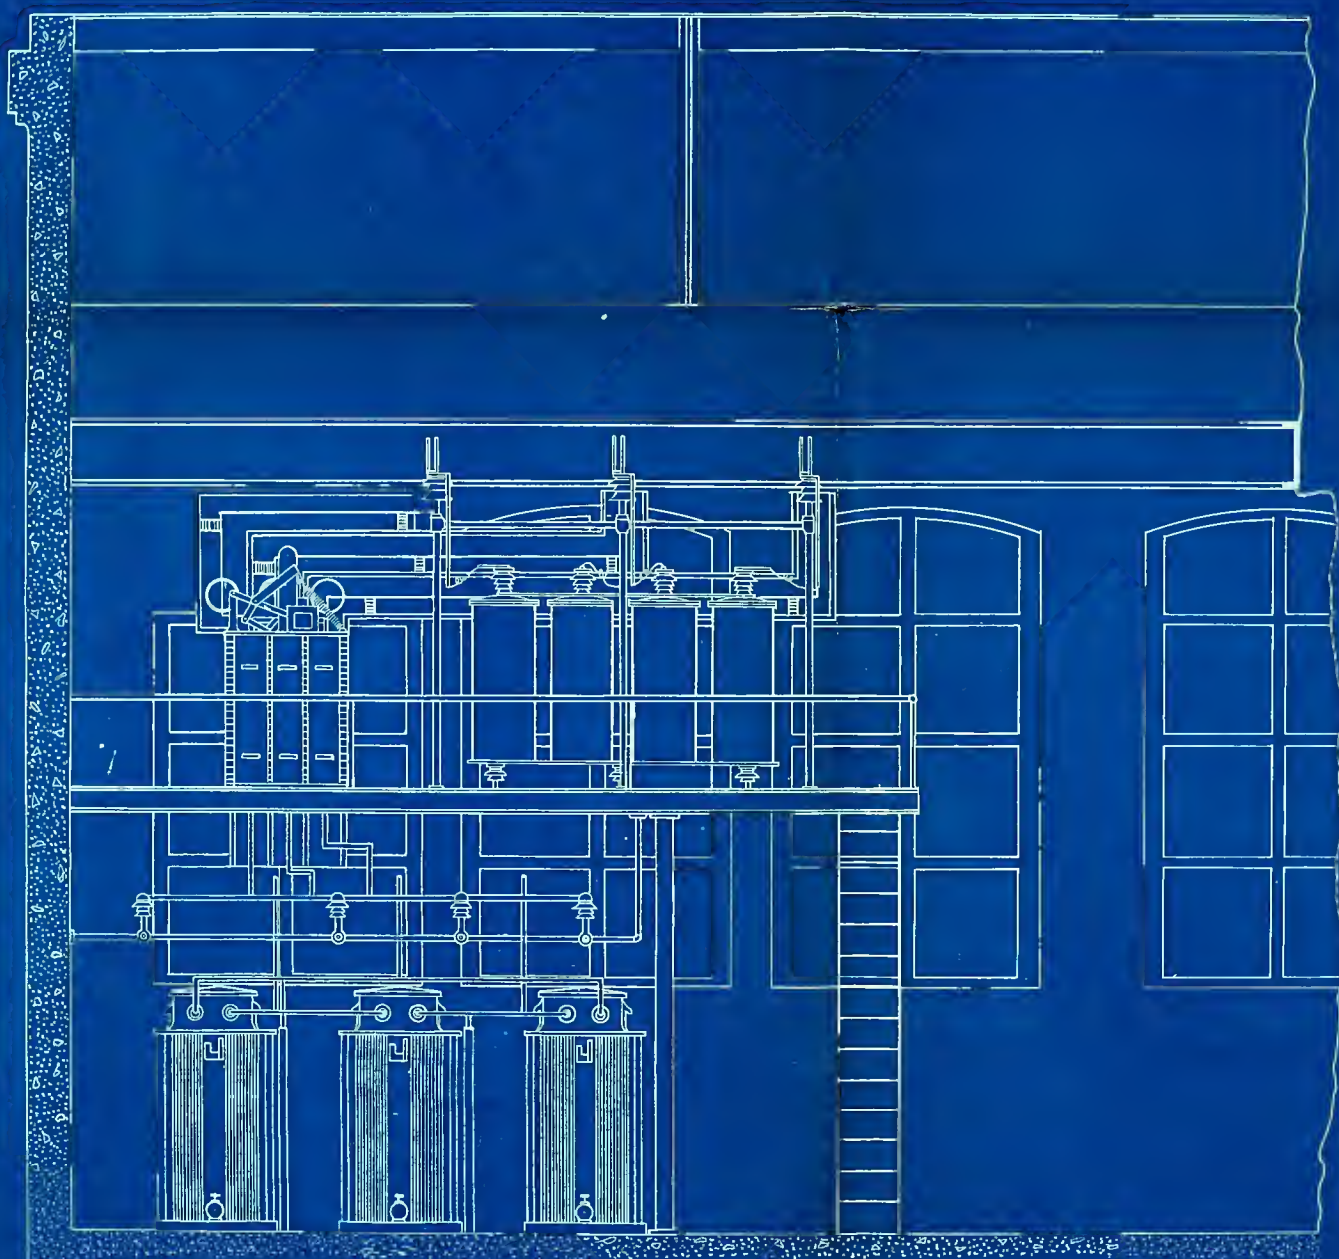

Elevation 33000 Volt Bus Structure



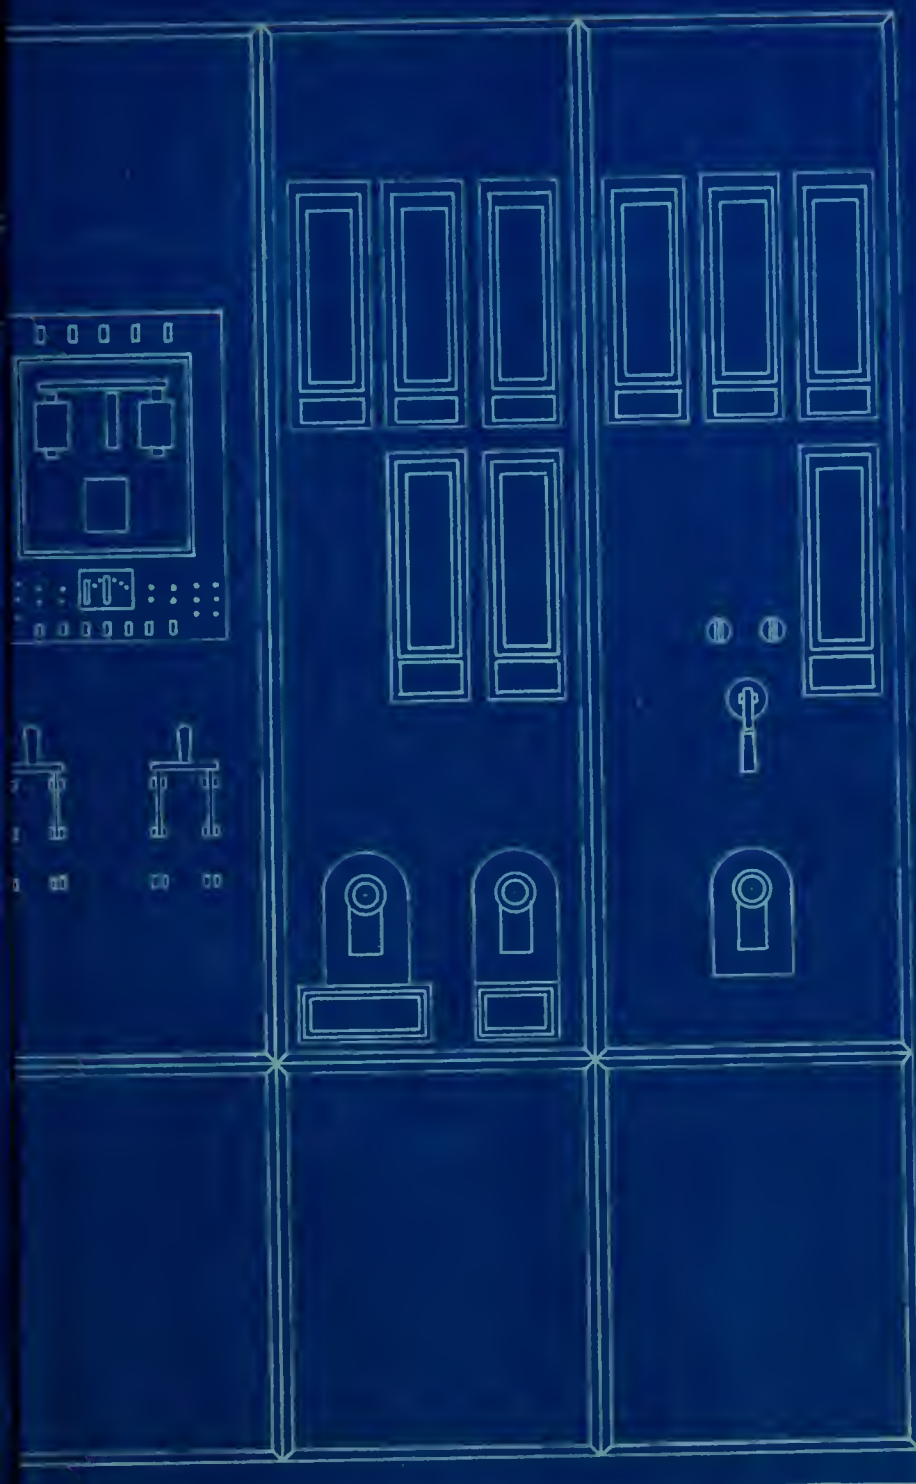

Regulator

200 KW. Feeder  
Station Lights


1200 KW. 33000 Volt  
Feeder

M. Baughman

E.D. MacEwing





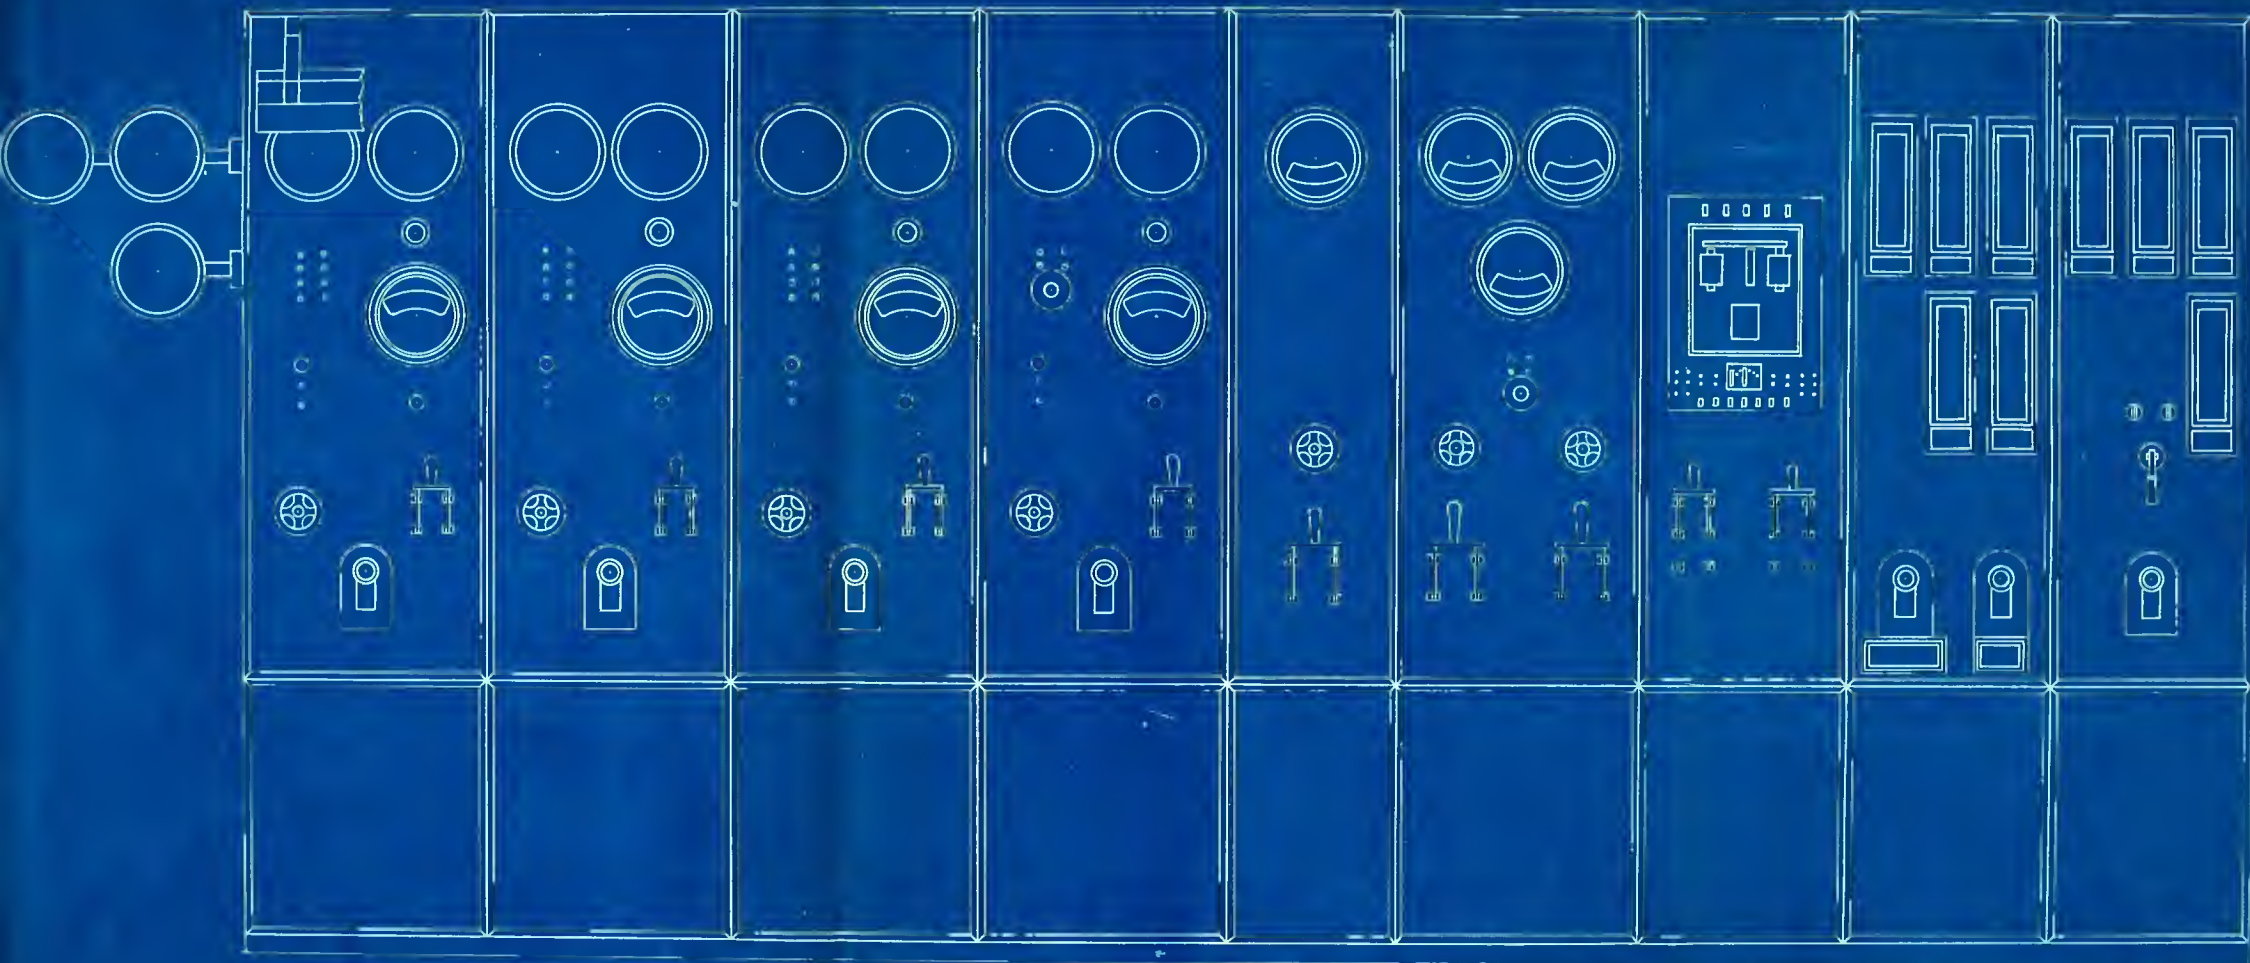

750 K.W. Generator

750 K.W. Generator

750 K.W. Aux. Gen.

750 K.W. Aux. Gen.

400 K.W. Exciter

Two 50 K.W. Exciter

Turbine Regulator


200 K.W. Feeder  
Station lights

1200 K.W. 33000 V.D.  
Feeder

M. Daughman E. MacSwigg






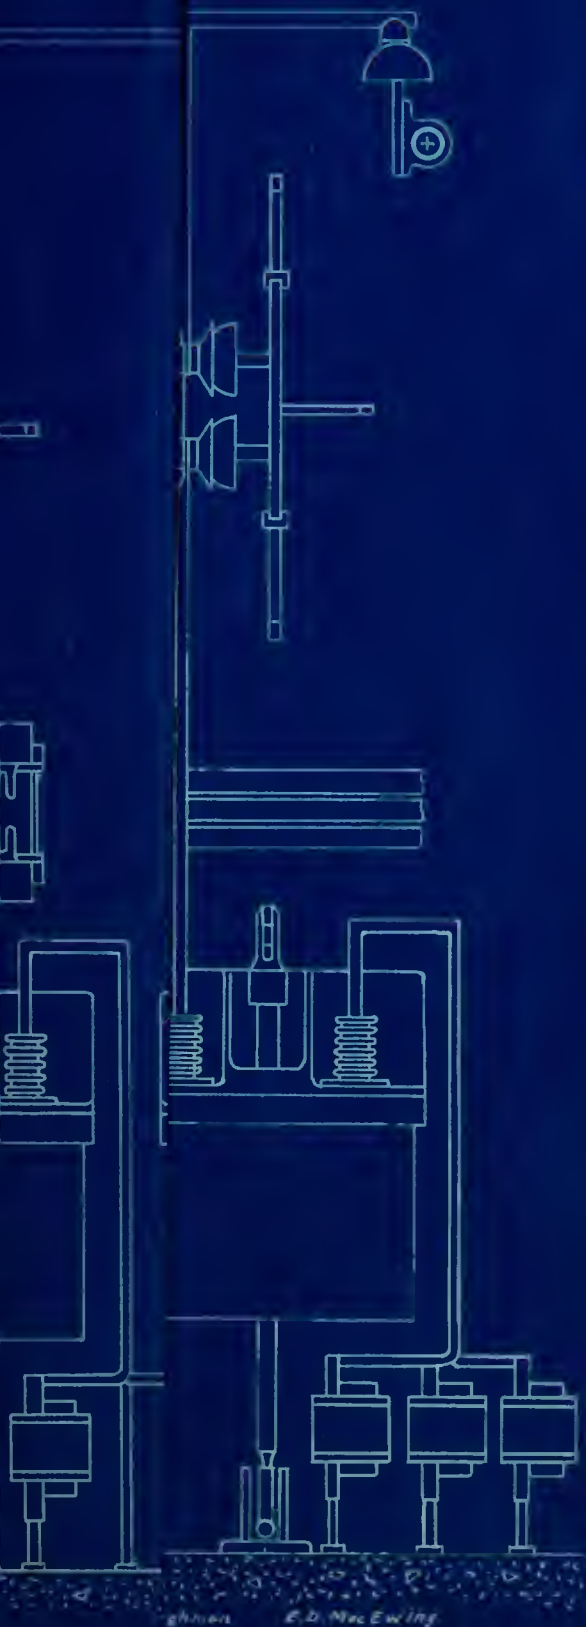


ghien. E.D. MacEwing.



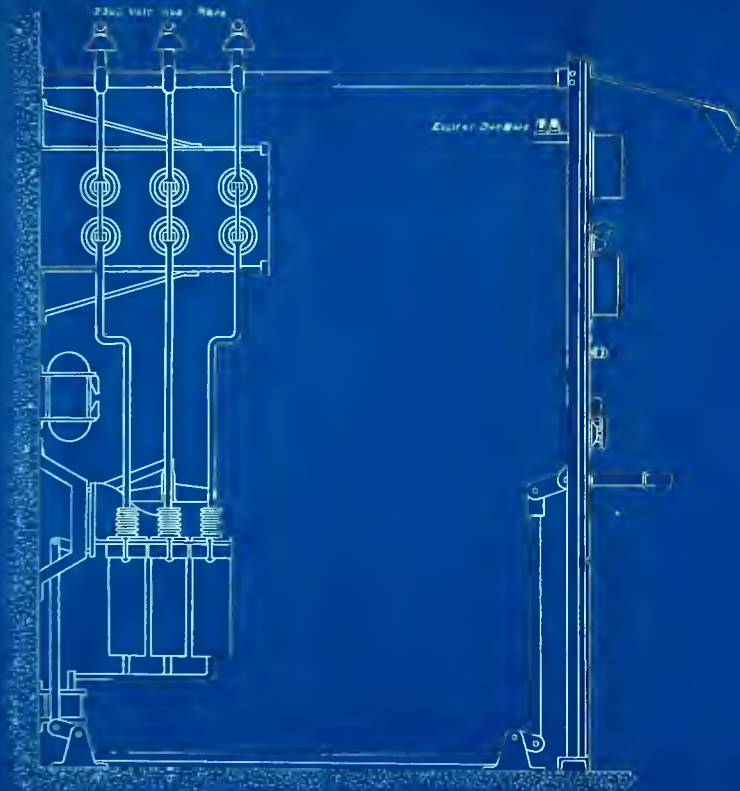


Section Generator - Panel

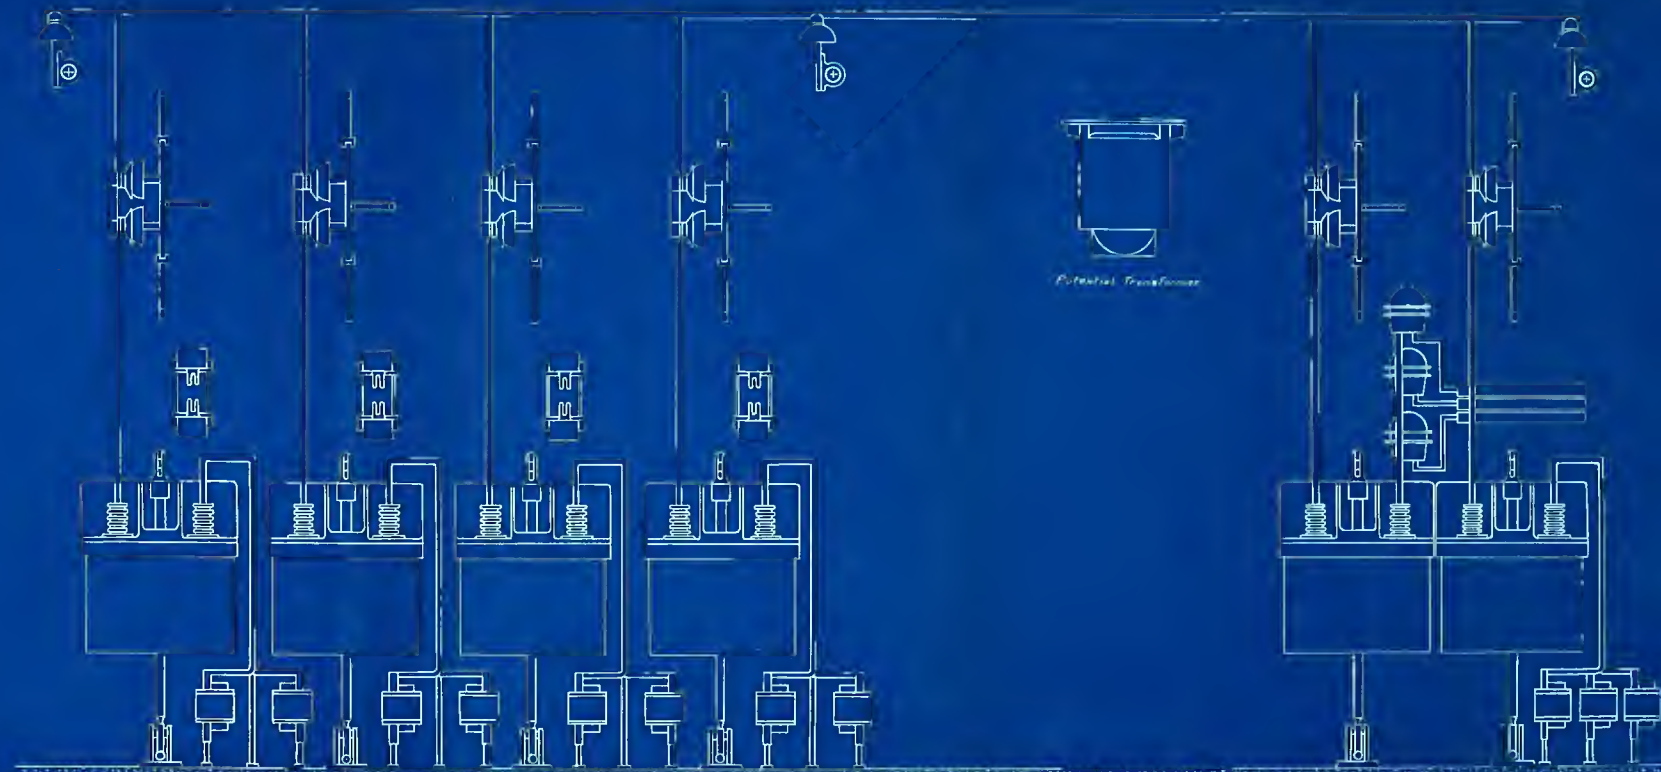

Elevation Oil Switches


J. N. Thompson E. J. Newberry



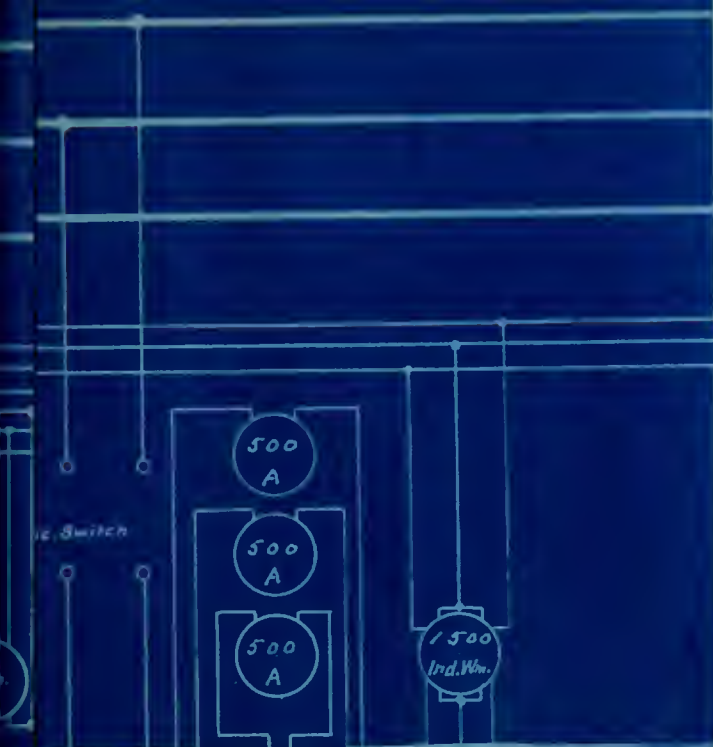





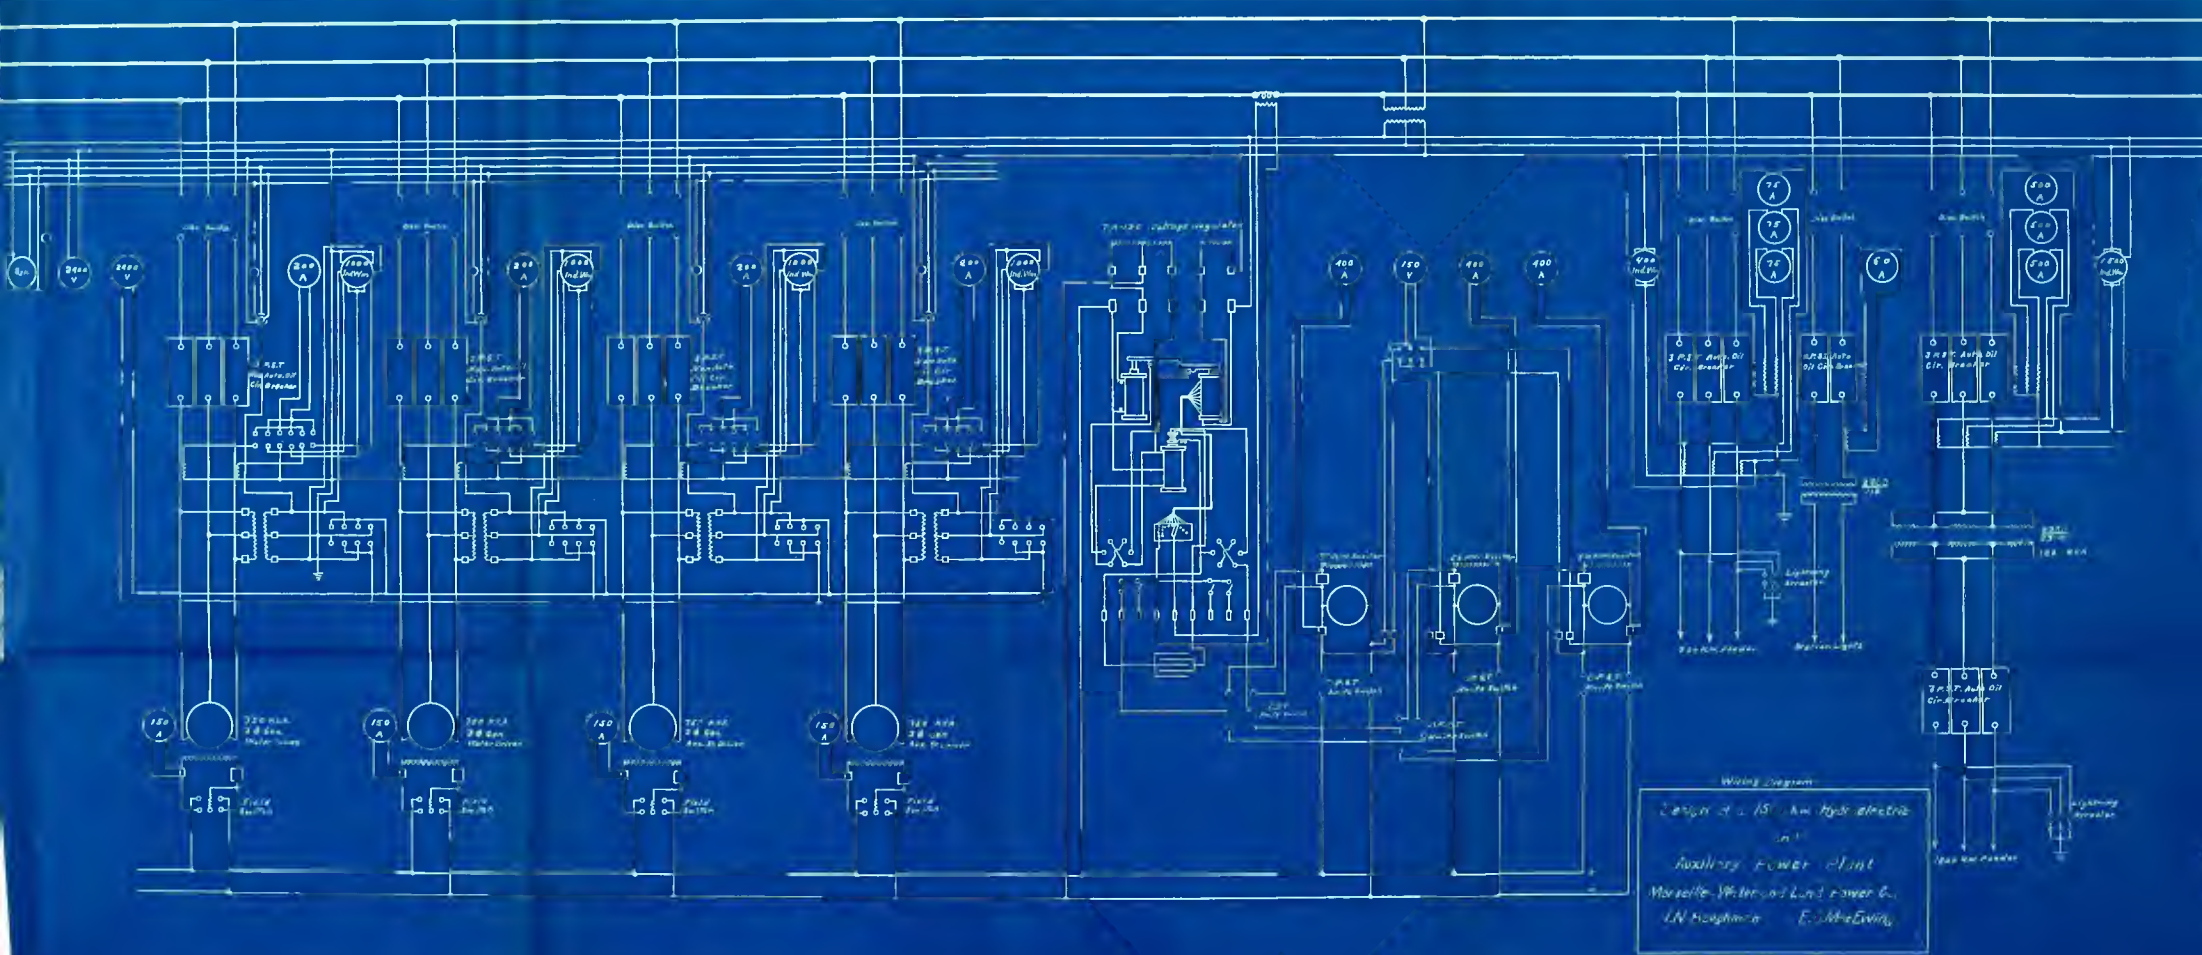



11"

8'-2"



FUSIBLE PLUG







5'-0"







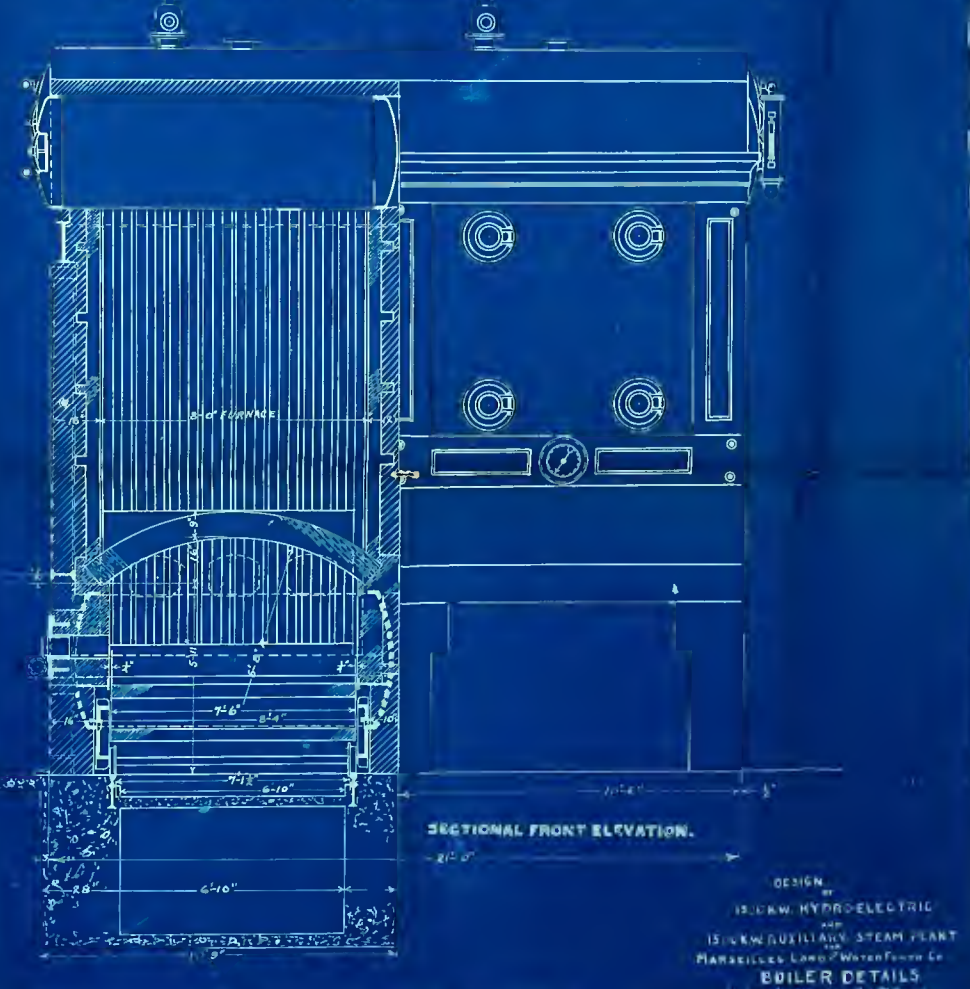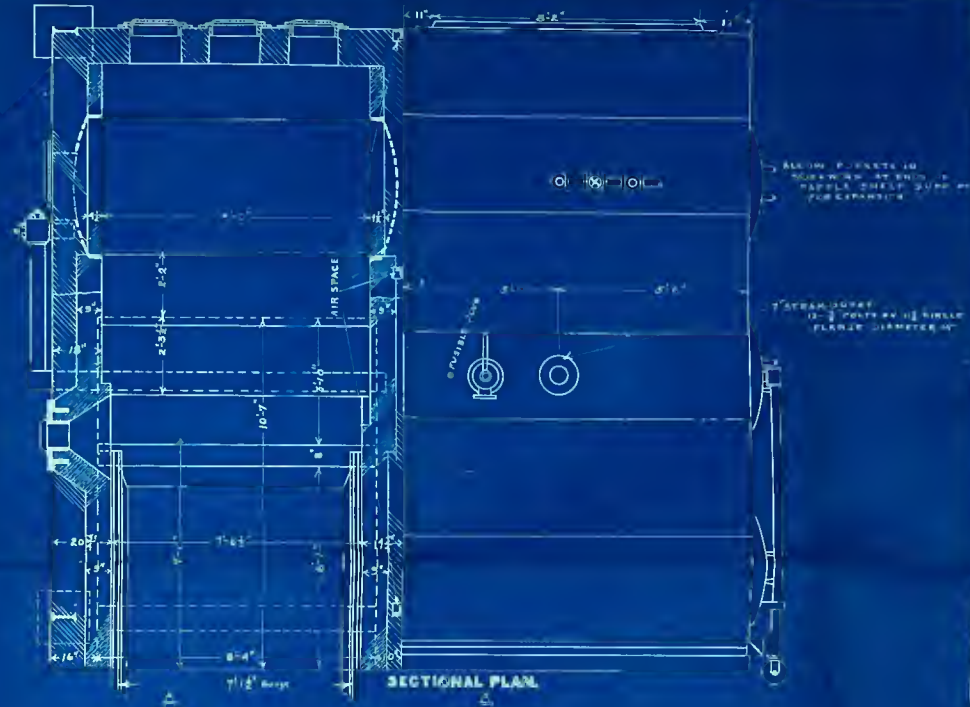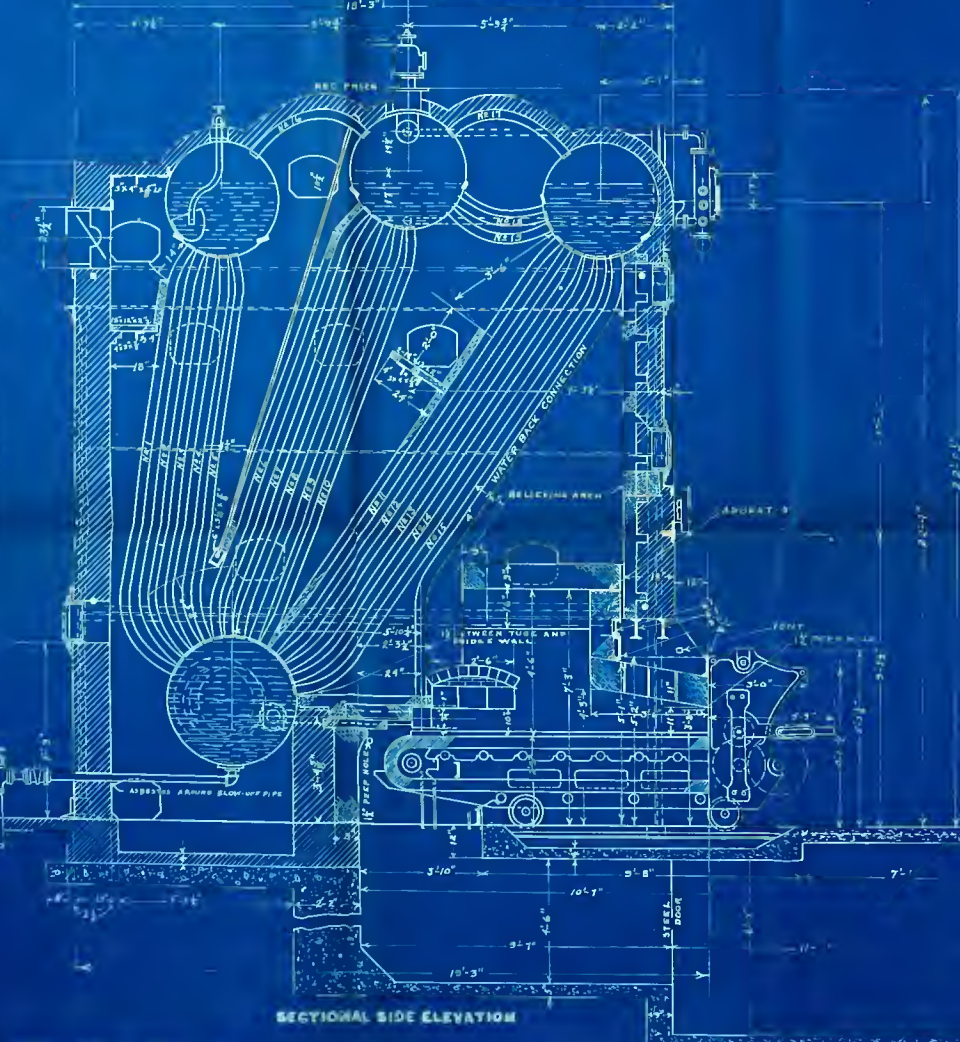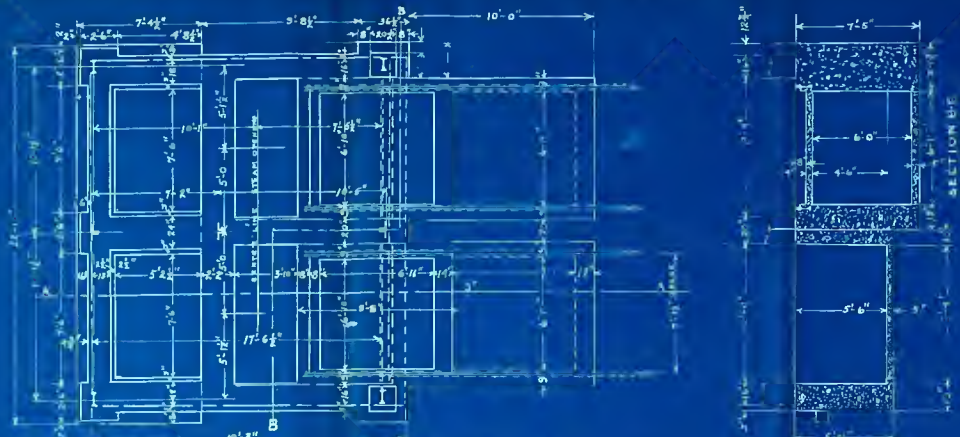


DESIGN BY  
 15,000 KW. HYDRO-ELECTRIC  
 15,000 KW. AUXILIARY STEAM PLANT  
 HANSEL & LLOYD WATER POWER CO.  
 BOILER DETAILS









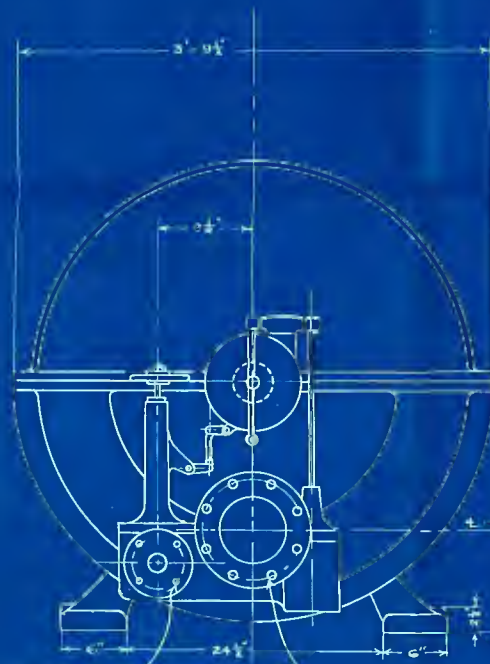


2" DIA STEAM INLET  
1/2" DIA OF FLANGE  
17" HOLE, 3" DIA. ON  
8" DIA BOLT CIRCLE

6" DIA EXHAUST  
11" DIA FLANGE  
8" HOLE 8" DIA. ON  
8" DIA BOLT CIRCLE

2" SCR FLANGE

4" P. STEAM INLET

4" P. EXHAUST

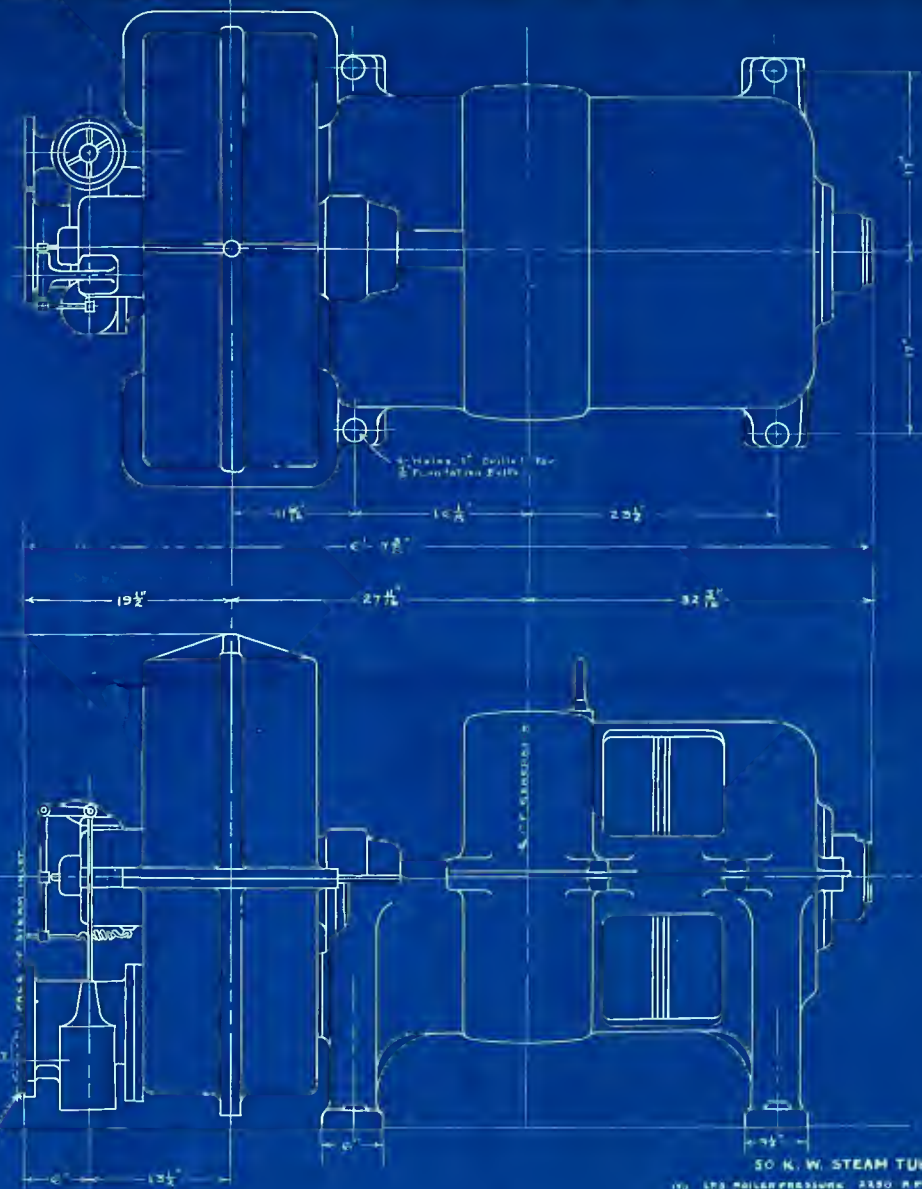

50 K. W. STEAM TURBINE

150 LBS. PRESSURE 2250 R.P.M.

MID-CONDENSING

DRIFT SUCTION TO

30KW-115VOLT D.C. GENERATOR

Rev'd By  
Washington  
March 1934

340477-1







